



BITE5

Battery tester

USER MANUAL

Notice

The information presented in this manual is believed to be adequate for the intended use of the product. If the product or its individual instruments are used for purposes other than those specified herein, confirmation of their validity and suitability must be obtained from Megger. Refer to the warranty information below. Specifications are subject to change without notice.

WARRANTY

Products supplied by Megger are warranted against defects in material and workmanship for a period of 1 years following shipment. The warranty is void in the event of abuse (failure to follow recommended operating procedures) or failure by the customer to perform specific maintenance as indicated in this manual.

Valley Forge Corporate Center
2621 Van Buren Ave
Norristown, PA 19403-2329

610-676-8500 (Telephone)
610-676-8610 (Fax)

www.megger.com

Contents

Introduction..... 5

Purpose of manual 5

Audience..... 5

Items received..... 6

Warning and safety precautions..... 8

Technical specifications 9

Connections and controls 11

Zero adjust..... 11

Configuration of BITE5 12

Configuration of string..... 14

Performing an impedance test 16

Performing an impedance test on a battery string. 18

Measuring and recording solar cell voltages and currents..... 21

Measuring and battery string voltages and currents..... 24

Performing a discharge test 27

Performing an impedance and discharge test (special testing) 30

Trending recorded data 33

Trending recorded impedance data 33

Trending recorded VA discharge data 36

Trending recorded impedance - discharge data 40

Viewing a record..... 44

Viewing meter impedance records..... 44

Viewing string impedance records 45

Table of contents

Viewing discharge impedance string records	46
Viewing meter VA records.....	47
Viewing Discharge VA String Records.....	49
Deleting recorded data.....	51
Deleting meter impedance data.....	51
Deleting discharge impedance string data	52
Deleting meter VA data	54
Deleting string VA data	55
Deleting discharge VA string data	56
Deleting a string configurations.....	58
Saving a screen snapshot	59
Accessories	60
Maintenance	61
Sales and manufacturing sites.....	63

Introduction

Thank you for your purchase of the Megger BITE5 Battery Tester. Be assured that your unit has been designed with emphasis on reliability, simplicity, and ease of use. It will provide you with the information you need to reliably test batteries.

Purpose of this manual

This document is the operator manual for the Megger BITE5 Battery Tester. It provides a description of the operation of the unit as well as operating instructions. Read this manual before installing or using the equipment. Special emphasis should be placed on all safety discussions.

Audience

This manual is written for technical personnel who are familiar with the various measurements performed by volt meters and current meters and have a general understanding of their use and operation. Such personnel should also be thoroughly familiar with the hazards associated with the use of this equipment and should have received proper safety training.

If you find any discrepancies in the BITE5 or have any comments, please send them to Megger via fax, e-mail, or phone.

Megger

Valley Forge Corporate Center

2621 Van Buren Avenue

Norristown, PA, 19403

Attn: Customer Service












Fax: (214) 331 7397

E-mail: USTechSupportGrp@megger.com



For Technical Support, please consult the Megger Web Site at www.megger.com for the local distributor near you.

Items received

Items received

Qty	Description	Image
1	BITE5 Battery Tester	
1	Duplex Probes	
1	Voltage Leads	
1	Charger	
1	Micro SD Card	
1	Micro SD Card Reader	
1	Mini USB Cable	
1	Neck Strap	
1	Zero Bar	
1	Stylus	
Optional	AC/DC CT	
Optional	PC Bluetooth Dongle	

Items received

Optional	11.75 mm (1/4") Tip Concentric Probes	
Optional	25.4 mm (1") Tip Concentric Probes	

Warnings and safety precautions

Safety

Warnings and safety precautions



WARNING!

Death, serious injury, or fire hazard could result from improper use/installation of this instrument. Read and understand this manual before installing this instrument.

Installation of this instrument **MUST** be performed in compliance with the National Electric Code and any additional safety requirements applicable to your installation.

Installation, operation, and maintenance of this instrument **MUST** be performed by qualified personnel only. The National Electrical Code defines a qualified person as one familiar with the construction and operation of the equipment and the hazards involved.

Safety Precautions

The following safety precautions **MUST** be taken whenever the instrument is installed:

- Wear safety glasses and insulated gloves when making connections to power circuits
- Hands, shoes, floor/ground must be dry when making any connection to a powered line

These warnings and safety precautions are to be used where appropriate when following instructions in this manual.



CAUTION!

The equipment could be impaired from improper use. Read the complete manual before use.



WARNING!

The equipment should not be used while its battery door is removed or if there is any visible damage to the case or if the hardware holding the unit together has been loosened.

Technical Specifications

Power supply	
AC charging adapter	Input 100 – 240 V AC (50/60 Hz) Output 12 V DC at 2.5 A
Battery pack	Li-Ion rechargeable pack > 5.4 Ah Voltage rating 7.4V Charge time 4 hrs Battery life > 8 hrs 300 charge/discharge cycles
Mechanical specifications	
Dimensions	240 x 160 x 65 mm 9.45" x 6.30" x 2.56"
Weight	0.9kg 1.98lbs
Shock and vibration	EN61010-1
Ingress/protection	IP54 EN60529 Electric IP2X terminal
Operating specifications	
Operating temperature	0 ~50 °C 32~122 °F
Storage temperature	-20 ~50 °C -4~122 °F
Charging temperature	10 ~40 °C 50~104 °F
Altitude	Operational 0 ~ 2000 m Non-operational 0 ~ 10 000 m
Relative humidity	10 ~ 85 % NC
Safety specifications	
CAT rating	500V CAT III, Pollution Degree 2
Standards	IEC61010-1:2010 (3rd Ed) EN61010-1:2010 (3rd Ed) IEN61326-1:2013 EN55011/A1:2010 (Class A) EN61000-3-2:2014 EN61000-3-3:2013
Markings	Double Insulated CE UKCA
Record capacity	
Memory	8 M Flash Storage
Impedance record	Max 1000 records
VA record	Max 512 records

Technical specifications

Electrical specifications		
Internal impedance		
Range	Resolution	Accuracy
3 mΩ	1 μΩ	+/- 1 % of reading +/- 10 digits
30 mΩ	10 μΩ	+/- 0.8 % of reading +/- 10 digits
300 mΩ	100 μΩ	
3 Ω	1 mΩ	
30 Ω	10 mΩ	
300 Ω	100 mΩ	
Voltage DC/AC		
Range	Resolution	Accuracy
5 V DC	0.00 1 V	+/- 0.5 % of reading +/- 5 digits
50 V DC	0.0 1 V	
500 V DC	0.1 V	
1000 V DC	1 V	
5 V AC	.001 V	+/- 0.75 % of reading +/- 5 digits (40 Hz – 100 Hz)
50 V AC	0.01 V	
500 V AC	0.1 V	
600 V AC	1 V	
Current DC/AC		
Range	Resolution	Accuracy
4 A DC	0.001 A	+/- 0.5 % of reading +/- 5 digits + (CT Tolerance)
40 A DC	0.01 A	
400 A DC	0.1 A	
1000 A DC	1 A	
4 A AC	0.001 A	+/- 0.75 % of reading +/- 10 digits + (CT Tolerance)
40 A AC	0.01 A	
400 A AC	0.1 A	
1000 A AC	1 A	
Temperature		
Range	Resolution	Accuracy
10 °C ~ 100 °C		
50 °F ~ 212 °F	0.1 °C	+/-1 °C +/- 2 digits
Ripple Voltage		
Range	Resolution	Accuracy
0 - 5 V	0.001 V	+/- 0.5 % of reading +/- 10 digits (40 Hz – 10 KHz)

Accuracy specifications assume an ambient temperature of 18 °C to 28 °C, stable within +/-1 °C and a warm-up time of 30 minutes.

Connections and controls


Connections

- Mini USB input and micro SD card slot
- Current probe input
- Voltage lead inputs
- Impedance probe inputs
- ON/OFF switch
- DC power adapter input



Controls

- Lock and unlock screen
- Ohmic testing
- VA testing
- Data and string records
- Recorded data charts
- Instrument configuration

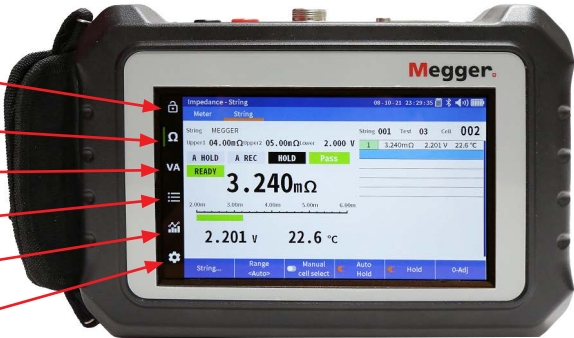


Zero adjustment

For accurate ohmic measurements, it is recommended that a zero adjust is performed when changing probes. To perform a zero adjust, use the included zero bar.




When performing a zero adjustment, place the source pin on the outer copper surface of the zero bar and place the sensor pin in one of the holes of the zero adjust bar.

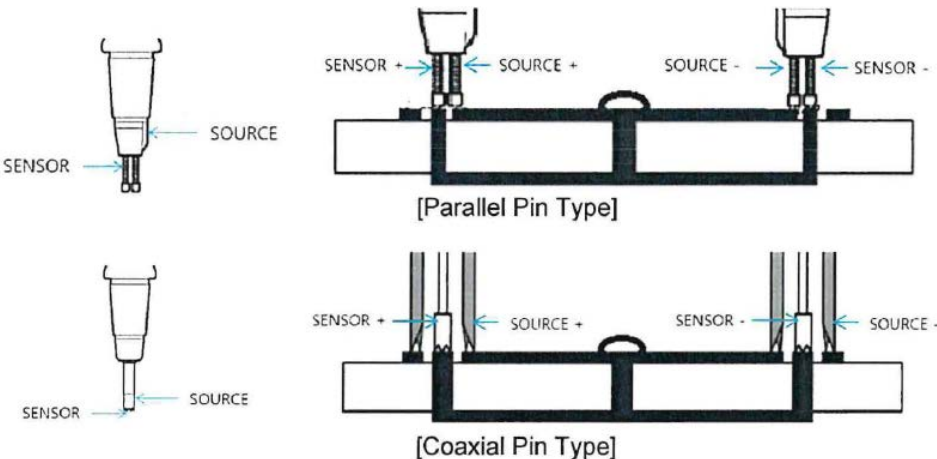

Configuración de BITE5

Procedimiento de calibración de cero

Seleccione "0-ADJ" (Calibración de cero).

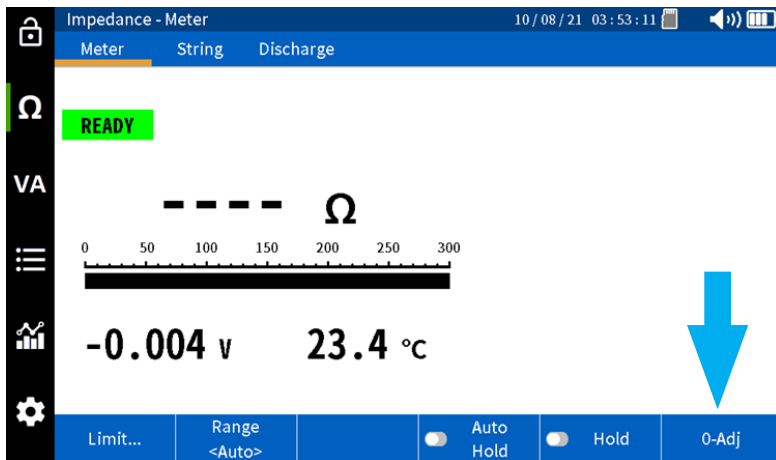


BITE5 le pedirá que utilice la barra de calibración de cero.

Seleccione YES (Sí).

NOTA: Coloque las sondas de barra de calibración de cero conforme a las indicaciones en los 10 segundos posteriores a elegir YES (Sí), o se agotará el tiempo de espera de BITE5.

Comenzará esta calibración de cero. Mantenga las sondas en la barra de calibración de cero hasta que termine la calibración.

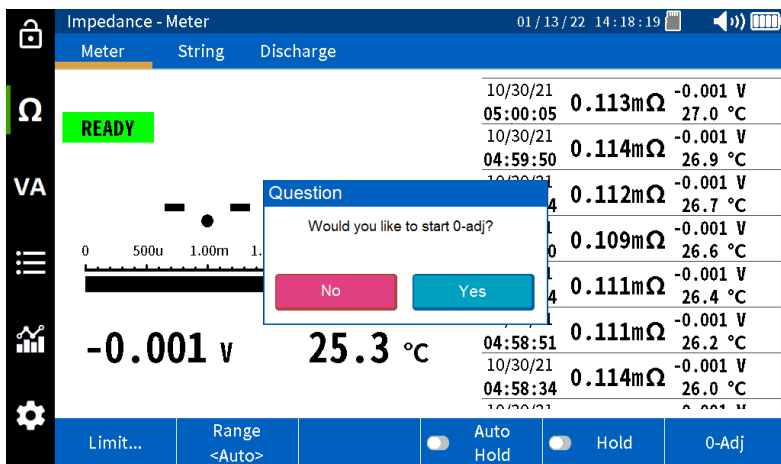


Uso

Configuración de BITE5

BITE5 le permite personalizar la unidad conforme a sus necesidades. Puede establecer el idioma que desee, el formato de fecha y hora, el brillo de la pantalla, un tiempo de espera automático para apagado de la unidad y la pantalla, el formato de temperatura y el volumen del timbre que prefiera. Esta pantalla también le permite formatear la tarjeta micro SD y restablecer las condiciones predeterminadas de la unidad.


ICONO DE CONFIGURACIÓN

To configure the unit, select the CONFIGURATION ICON.

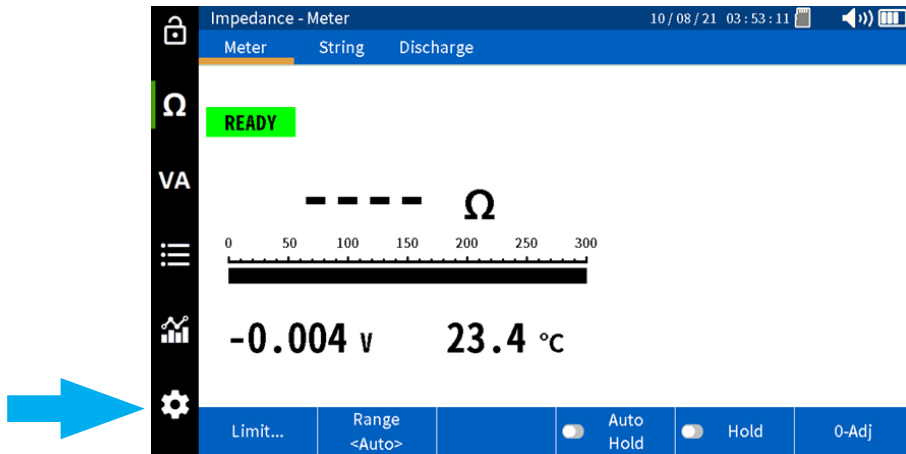


Under the impedance tab, the temperature measurement scale can be selected (Celsius or Fahrenheit).

Then select the "Etc" tab.

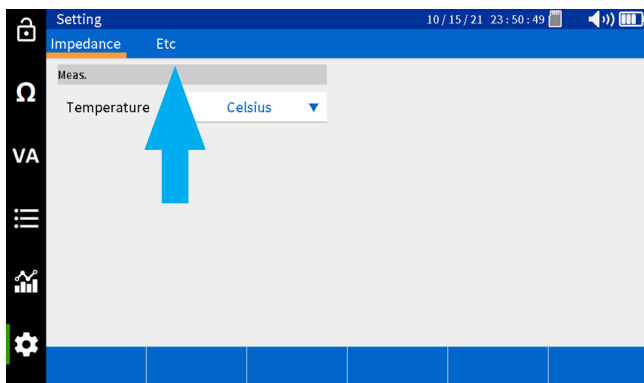

This screen allows you to customize the settings of your BITE5.

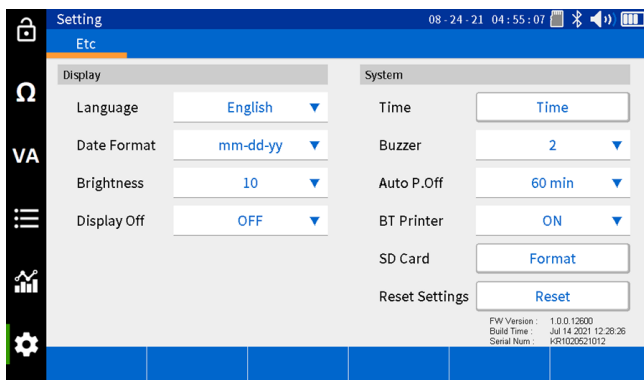

From this screen you can select the following:

Language	Set the instrument language
Date format	Select the desired date format
Brightness	Set the brightness setting of the display screen


Configuration of string

Display off	Set a display time out. After an amount of time of no activity, the display will turn off. Simply touch the screen to re-activate the display
Time	Set the date and time of the instrument
Buzzer	Set the volume of the buzzer or disable it
Auto P. off	Set a unit power off time out. After an amount of time of no activity, the instrument will turn off
BT printer	Enable or disable the optional bluetooth printer
SD card	Format the micro SD card. NOTE: This will cause all data and configurations to be erased
Reset settings	Resets the instrument settings to default factory settings


Configuration of string

The BITE5 allows you to configure strings. The configuration allows you to assign the string a name, input the type of battery, the number of batteries, and the model of the battery. In addition, you can enter baseline reference data as well as warning and alarm limits.


To configure a new battery string press the RECORD ICON.

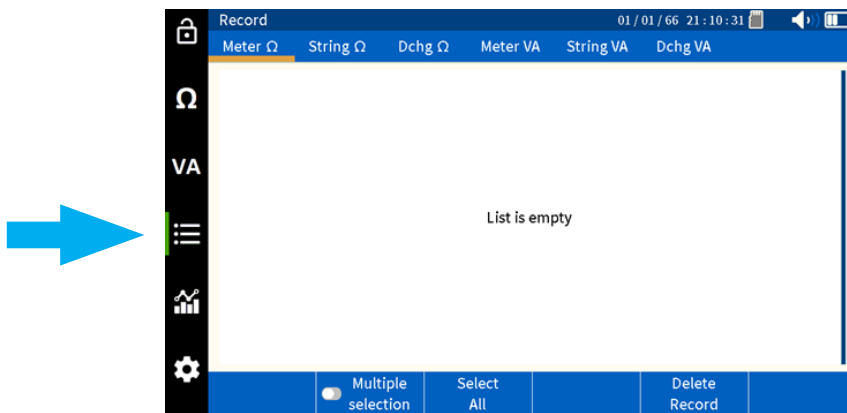


Select "String Ω".

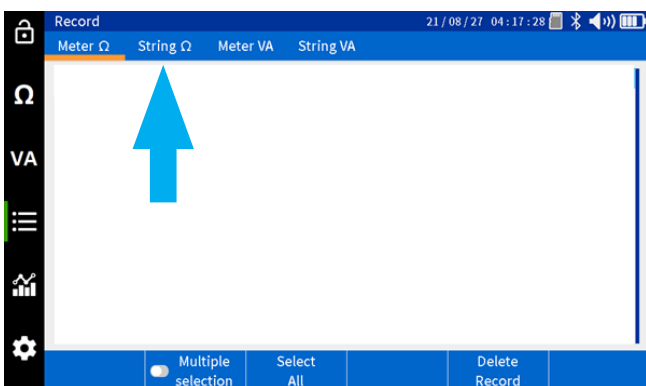

Select "Add..."

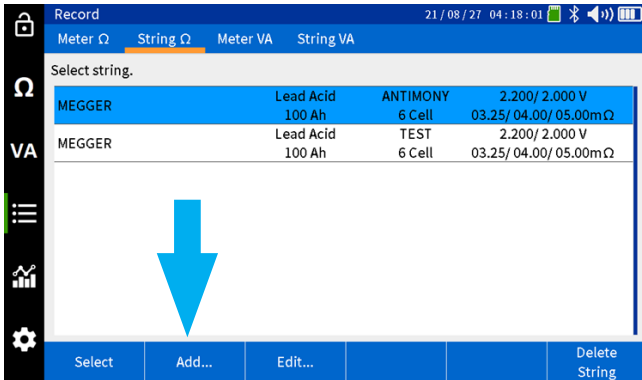

This will open the String Configuration screen.

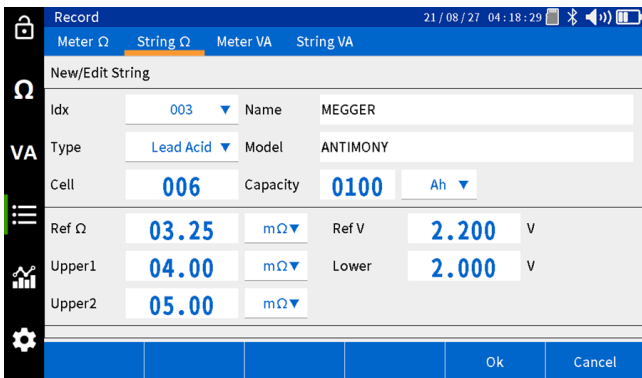

Idx	Sets an index number for the string in the BITE5. This is set automatically. It can be set manually if desired
Type	Select the type of battery to be tested: Lead acid Ni-CD Ni-MH Li-ion Li-poly
Cell	Cell
Name	Name of string
Model	Model number of batteries
Capacity	Battery capacity in Ah or mAh
Ref Ω	Baseline reference value
Warning	Warning upper ohmic limit
Alarm	Alarm upper ohmic limit
Ref V	Cell float voltage
Lower	Low voltage limit

When the setting are complete, select OK to save the string configuration.

Performing an impedance test

Performing an impedance test


In the ohm mode, the BITE5 will record and save voltages, impedance values and temperature. These measurements can be performed on individual cells or sequentially on battery strings. These measurements can be taken on any individual battery up to 200 V DC.

Operation:


Measuring and saving individual battery measurements.

Connect the impedance leads to the input connector of the BITE5.

On the BITE5 select “Ω”.

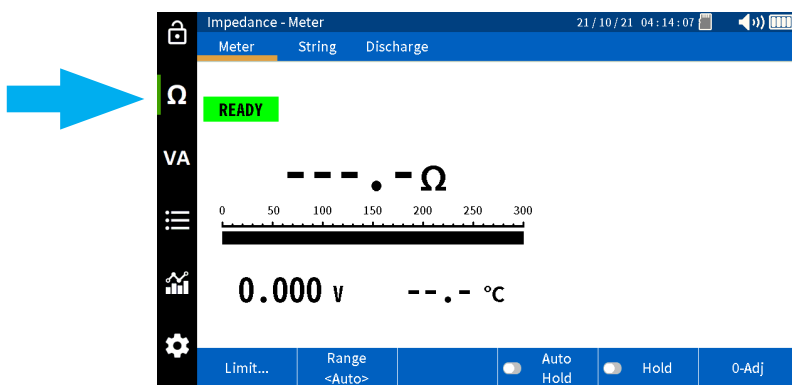


Select “Meter”.

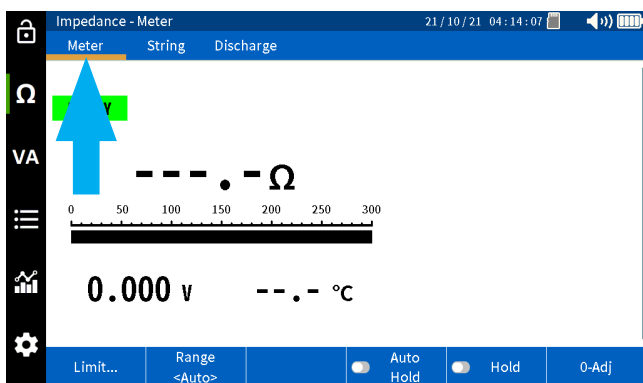


Performing an impedance test

Select "Limit" if you would like to program impedance and voltage limits for the measurement.

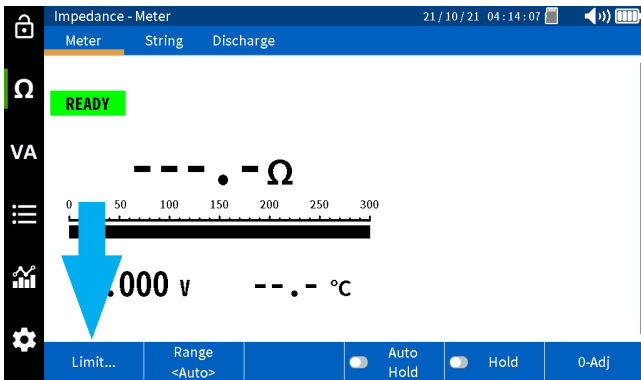


This screen will allow you to program a warning and alarm limit for the impedance value and a lower limit for the voltage. This is an optional step. Select OK when done.

Note this feature can be disabled as well by selecting OFF.

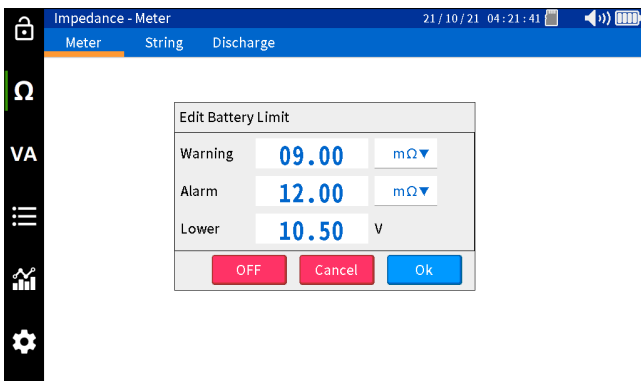


Start testing by place the probes across the battery.

The BITE5 will beep when the measurement is complete.

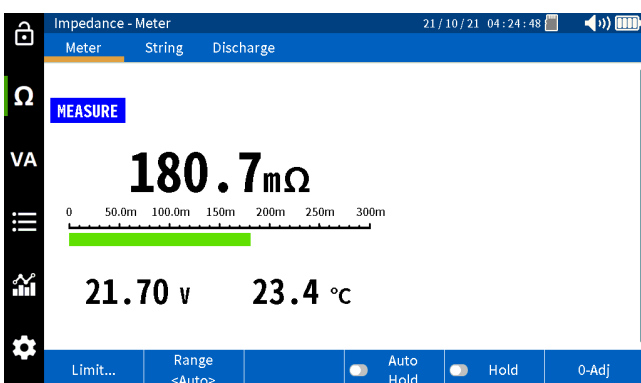


Performing an impedance test on a battery string

Press "Hold" to freeze the value on the screen.

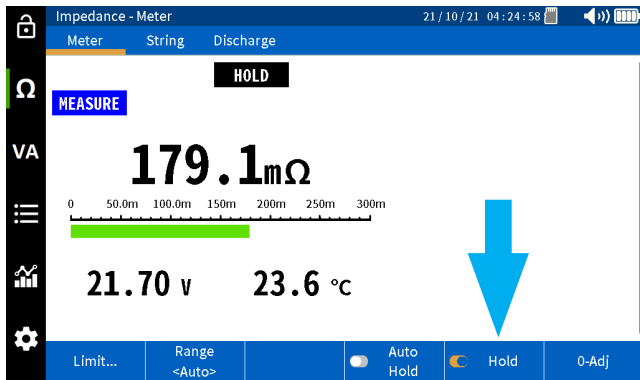

Automatic Saving of Values

Select "Auto Hold" and the BITE5 will automatically save any measurement with a date and time stamp.

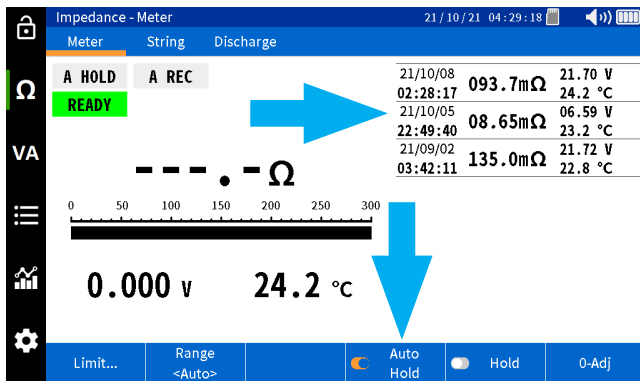


Performing an impedance test on a battery string.

Connect the impedance leads to the input connector of the BITE5.




On the BITE5 select "Ω".

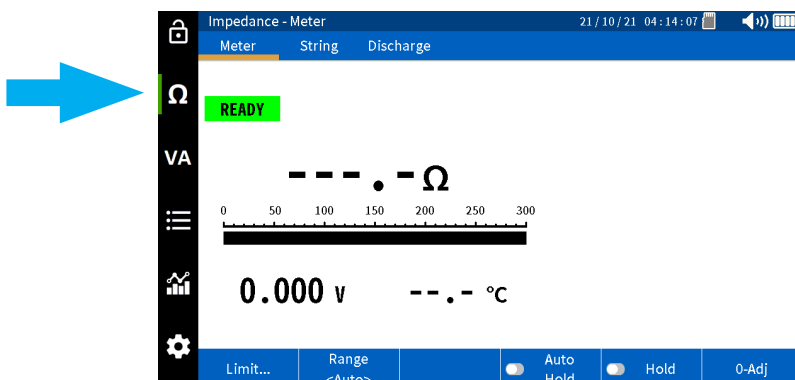


Performing an impedance test on a battery string.

Select "String".

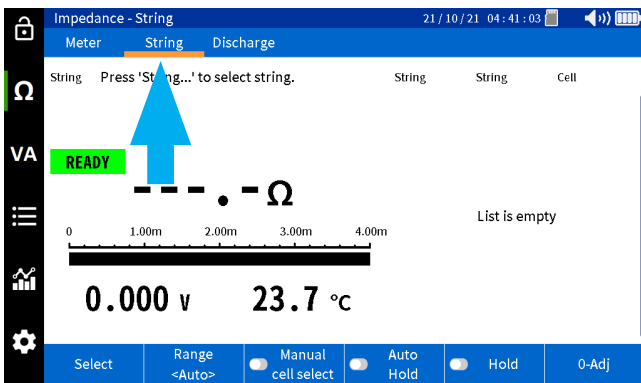


Select "Select".

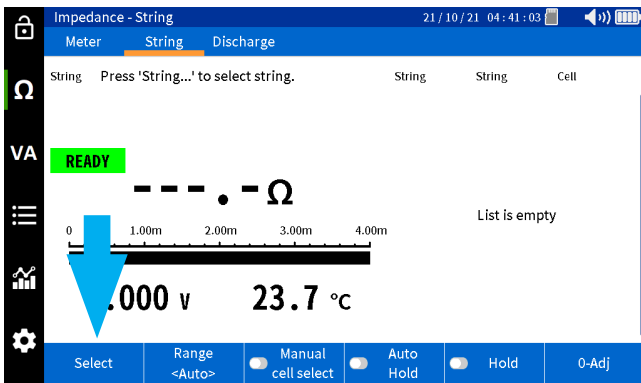

Select desired string. Select "New Test" to start a new test on the selected string.

Select "Select Test" if you wish to continue a test that was already in progress.

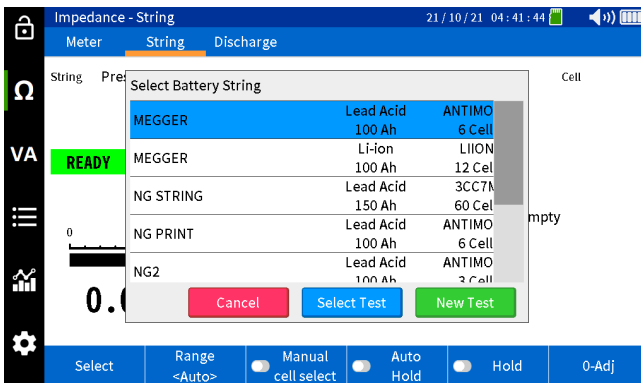


Performing an impedance test on a battery string.

Start testing by placing the probes on the first cell in the string.


The BITE5 will beep when the measurement is complete and save the cell voltage, cell impedance, and cell temperature to memory automatically.

The results will be displayed on the screen.

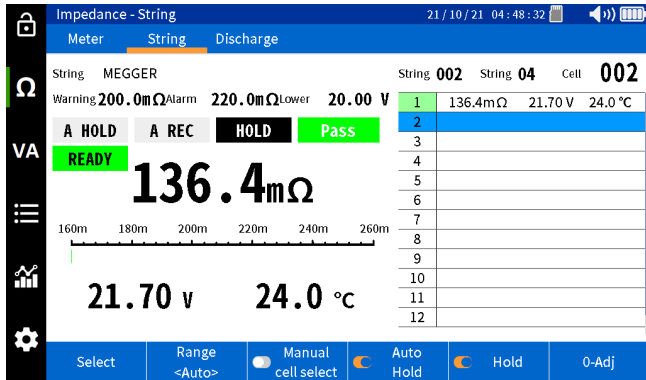


Move to the next battery in the string and take a measurement.

The recorded values will be displayed on the screen.

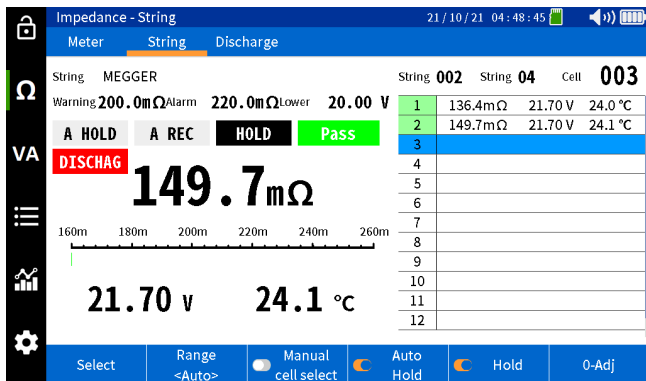

Continue taking a measurement of each cell in sequence on the string until you reach the last cell in the string.

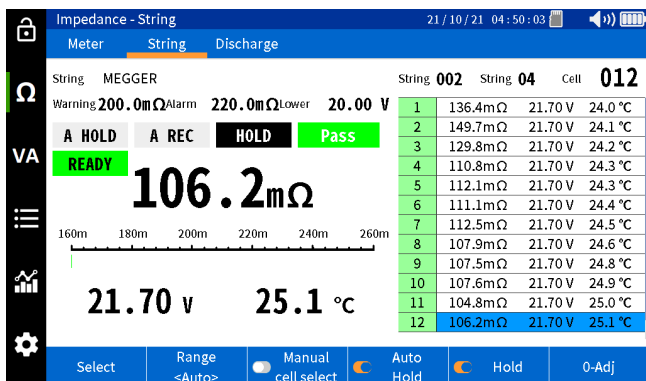

Measuring and recording solar cell voltages and currents

Measuring and recording solar cell voltages and currents

In the VAMETER mode, the BITE5 will record and save voltages and currents with a date and time stamp. These measurements can include solar cells, combiner boxes, DC or AC panels, and UPS output or input voltages. The BITE5 will save values for any voltage up to 1000 V DC and 600 V AC.

Operation:

Connect the voltage leads to voltage inputs of the BITE5.


If measuring current, then plug the CT into the BITE5 CT input.




Select the desired current range on the CT.



On the BITE5 select "VA".

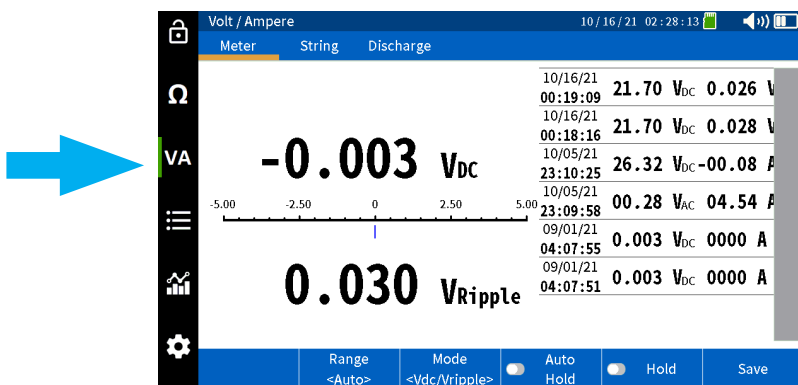

Select "Meter".

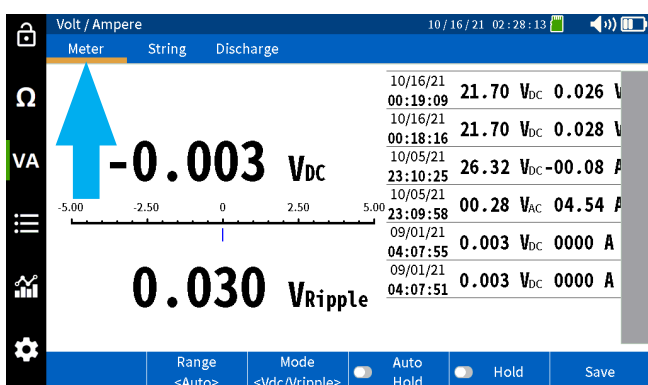


Measuring and recording solar cell voltages and currents

Select desired measurement.


V DC and V ripple

V DC and Amps DC


V AC and Amps AC

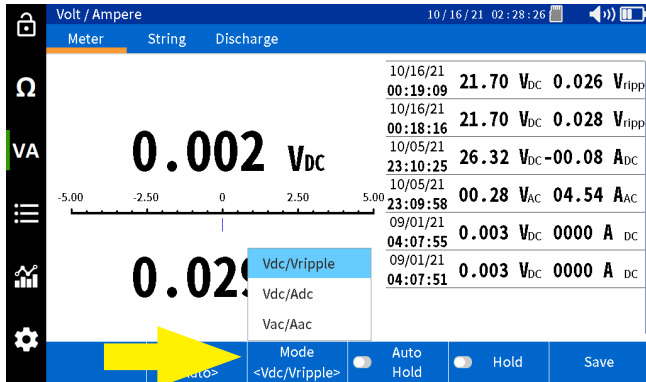

If using the CT set the correct range on the BITE5.

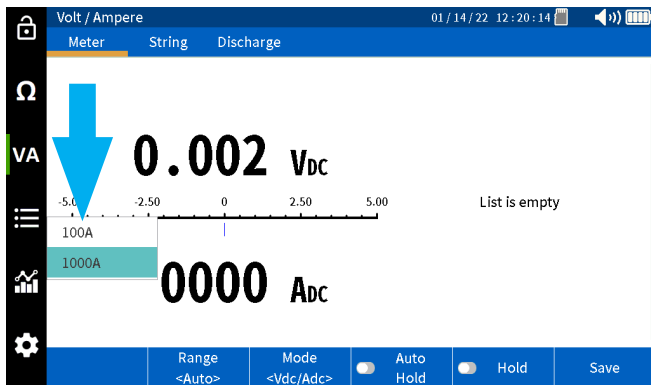


Take measurement.

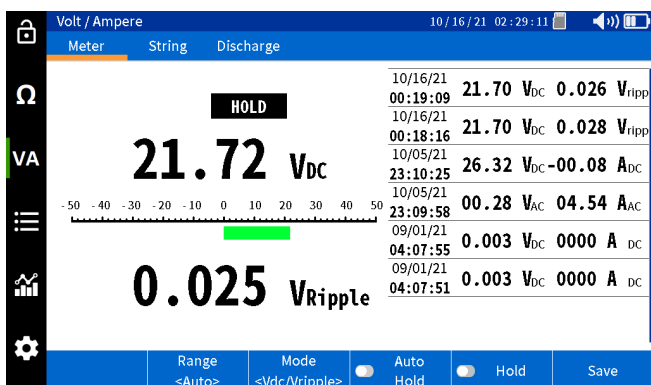


Measuring and recording solar cell voltages and currents

Press "Hold" to freeze the measurement on the screen.

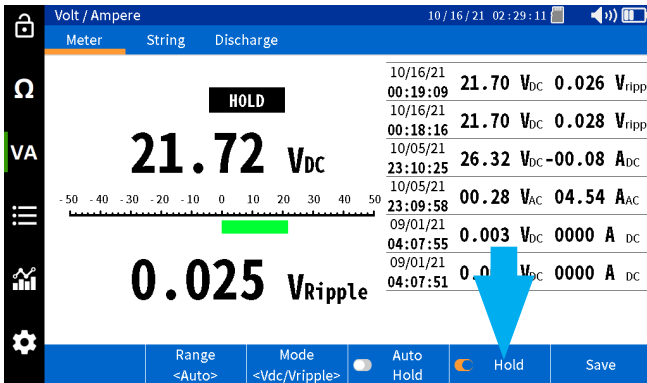


Press "Save" to manually save the value with a date and time stamp.

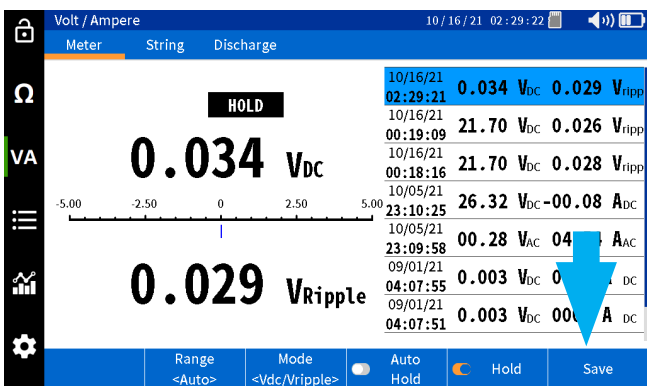

Automatic saving of values

Select "Auto Hold" and the BITE5 will automatically save any measurement with a date and time stamp.

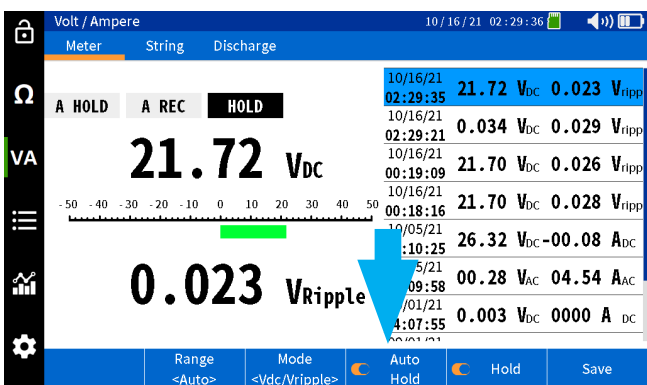

Measuring and battery string voltages and currents

Measuring and battery string voltages and currents

The BITE5 can be used to measure and record the DC voltage across the string, the ripple voltage, the DC float current, and the AC Ripple Current flowing through the string. These values will be saved to the selected string data and will have a date and time stamp.

Operation:

Connect the voltage leads to voltage inputs of the BITE5.


If measuring current, then plug the CT into the BITE5 CT input.




Select the desired current range on the CT.



On the BITE5 select "VA".

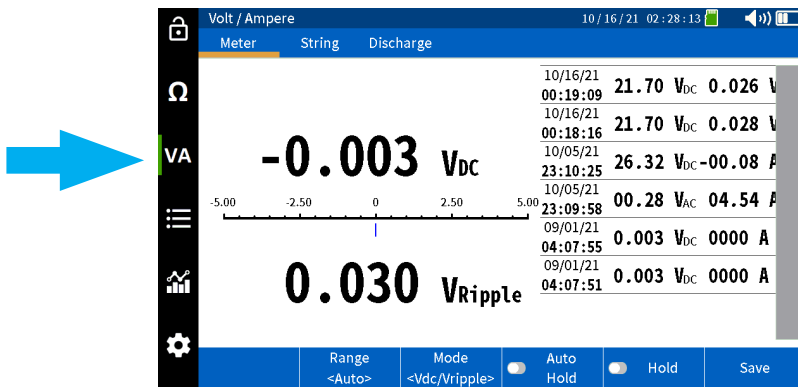


Select "String".

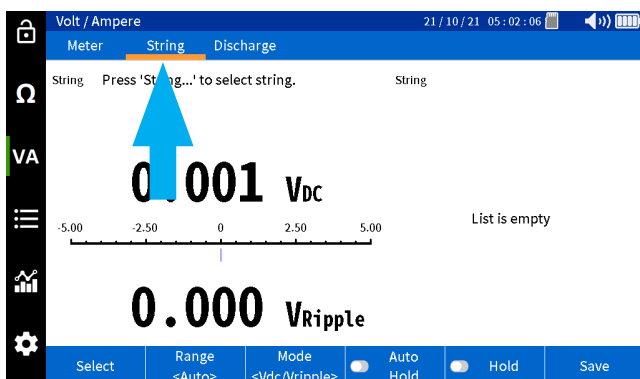


Measuring and battery string voltages and currents

Select "Select".

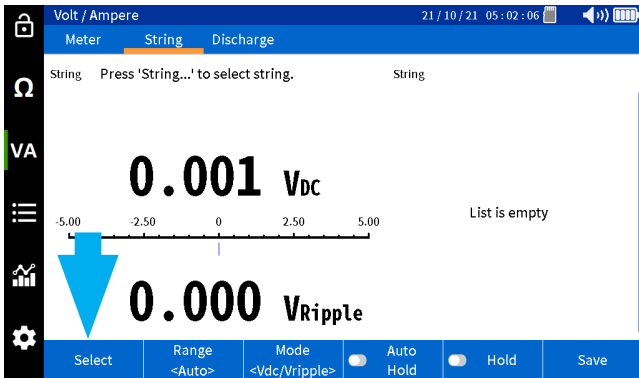

Select desired battery string, then press OK.

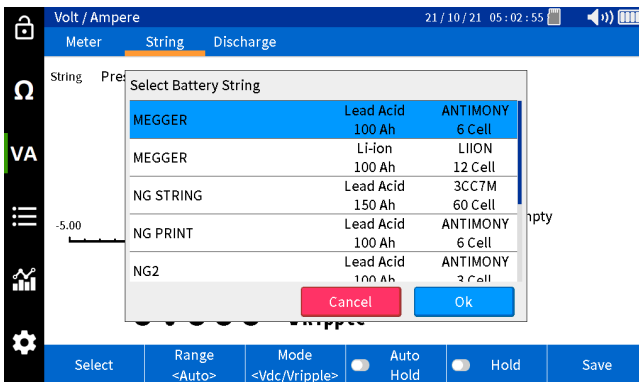


Select desired measurement.

V DC and V ripple


V DC and Amps DC

V AC and Amps AC

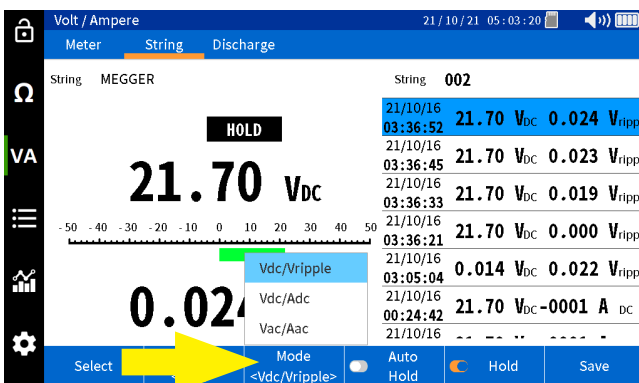


Measuring and battery string voltages and currents


If using the CT, set the correct range on the BITE5.

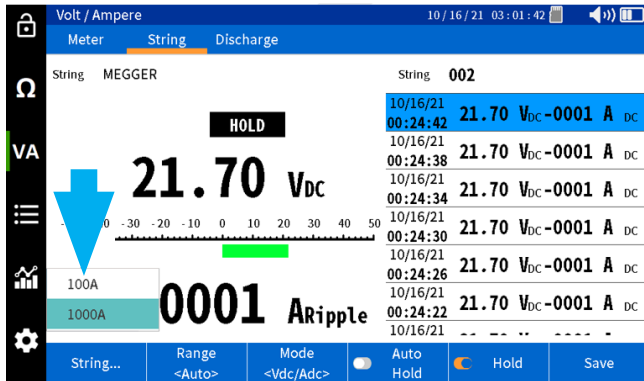


Take measurement.

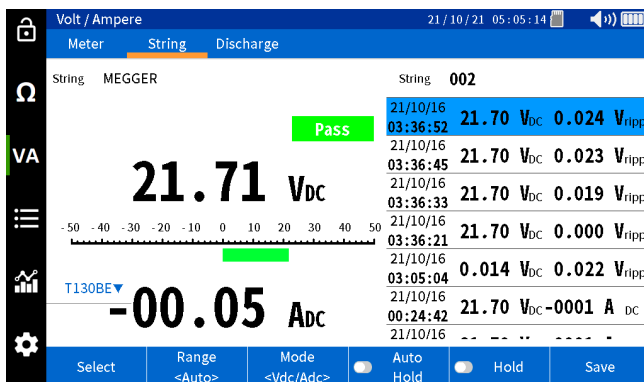

Press "Hold" to freeze the measurement on the screen.

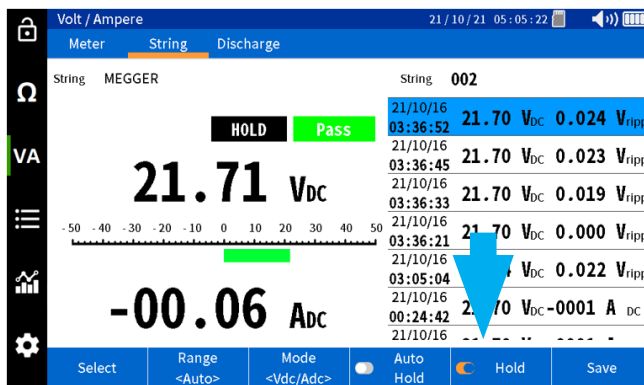


Press "Save" to manually save the value with a date and time stamp.

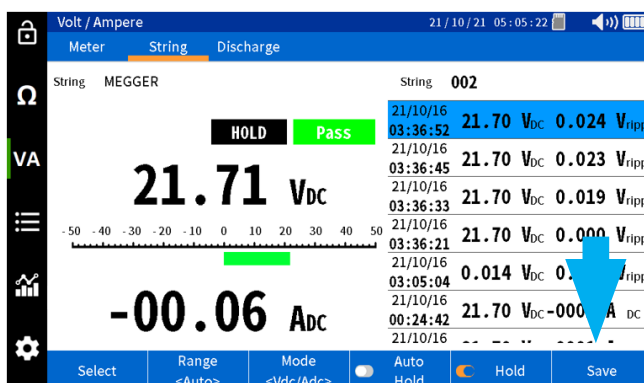

Automatic saving of values

Select "Auto Hold" and the BITE5 will automatically save any measurement with a date and time stamp.

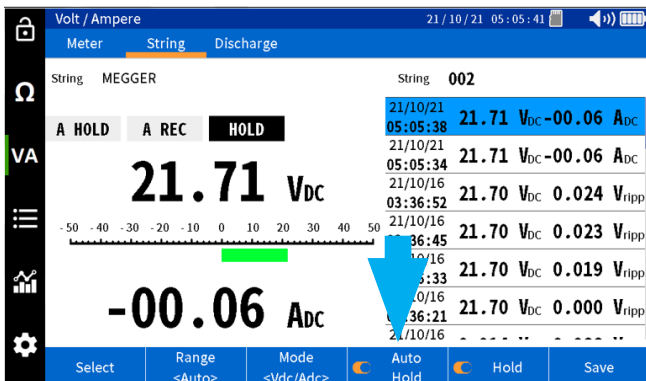

Performing a discharge test

The BITE5 can be used in conjunction with the Megger Torkel discharge tester. Program the Torkel for the desired discharge test. Place the Torkel across the battery string and start the discharge test. The BITE5 can then be used to take manual measurements of the cell voltage throughout the discharge process.

In this mode, the unit will record the DC voltage of each cell as well as the DC current through the string if the optional Hall Effect CT is used.

Operation:

Connect the voltage leads to voltage inputs of the BITE5.

If measuring current, then plug the CT into the BITE5 CT input.




Select the desired current range on the CT.




Performing a discharge test


On the BITE5 select "VA".

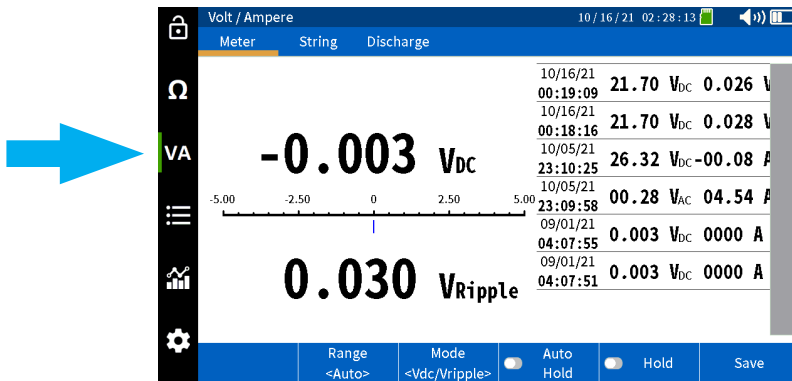


Select "Discharge".

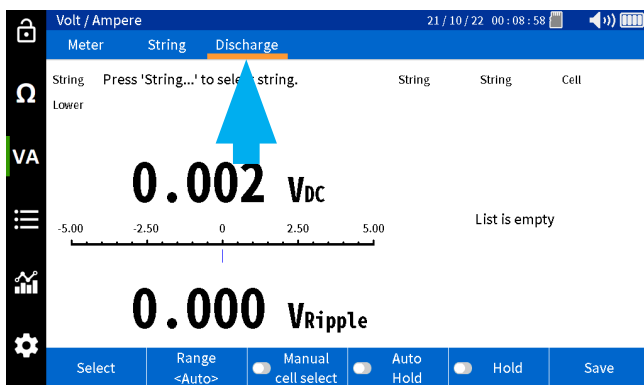

Select "Select".

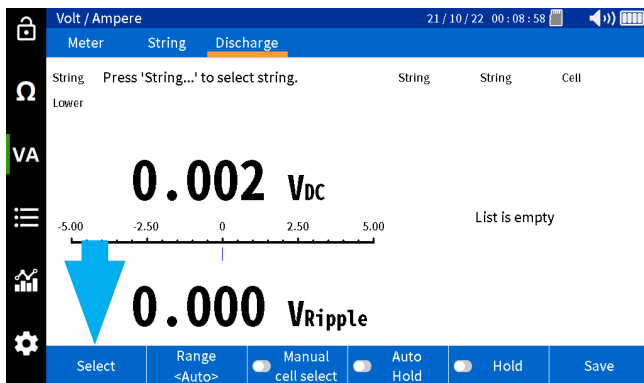


Select desired battery string, then press OK.

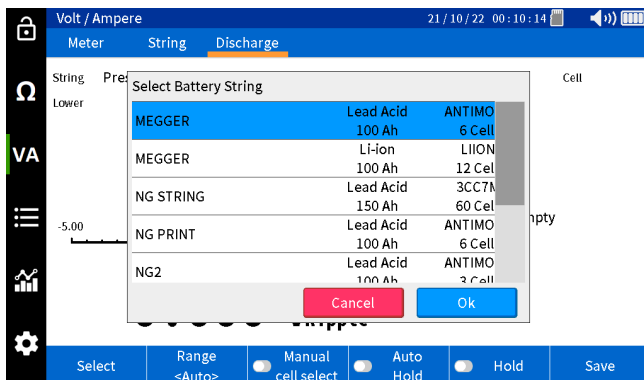


Performing a discharge test


Choose whether to continue a previous test or start a new test under that string.

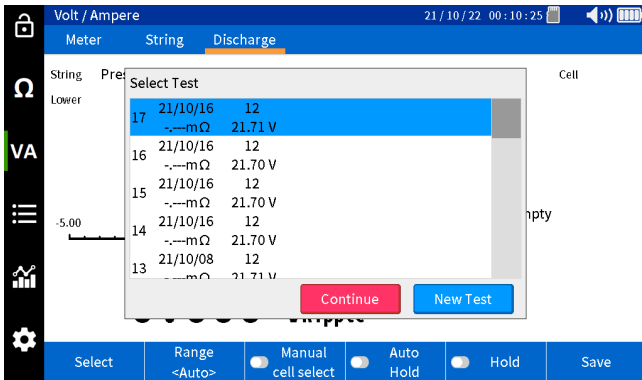


If using the CT, set the correct range on the BITE5.

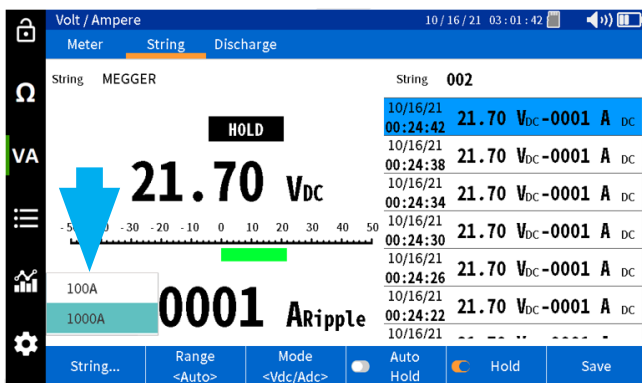

Take measurement of the first cell. The DC voltage and DC current will be saved with a date and time stamp.

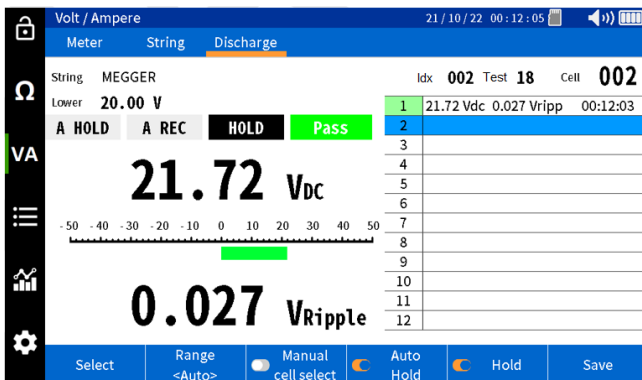


Take measurement of the each following cell. Each measurement shall be saved in sequence with a cell number, date and time stamp.

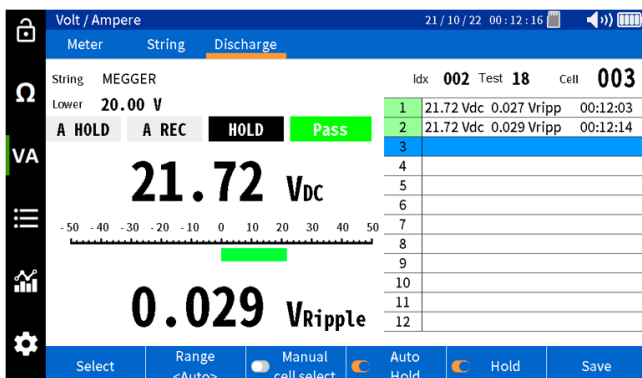

Performing an impedance and discharge test (special testing)

When the end of the string is reached, the unit will prompt the user to either end the test or select “next” to perform the next pass through the string.

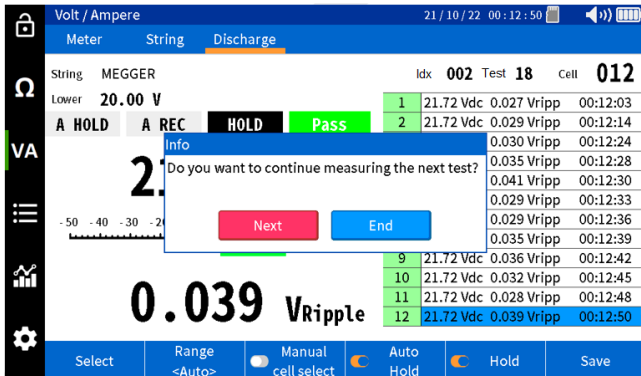

Performing an impedance and discharge test (special testing)

The BITE5 can measure the voltage and temperature and impedance throughout a discharge test. Performing this test will allow the trending of the cell impedance throughout the discharge process. This will allow the operator to establish an ohmic value that correlates with the discharged battery. This value can then be set as the alarm (upper 2) limit for the string.

NOTE: This value will be associated with the internal impedance changes associated with sulfated plates. It may not correlate with other causes of cell aging such as plate corrosion.

In this mode the BITE5 will also measure the cell temperature during the discharge. The temperature will be taken off the negative plate. This will be valid only for sealed batteries. Flooded cells the temperature should be taken from the electrolyte.

Program the Torkel for the desired discharge test. Place the Torkel across the battery string and start the discharge test. The BITE5 can then be used to take manual measurements of the cell voltage throughout the discharge process.

In this mode, the unit will record the DC voltage of each cell as cell impedance and cell temperature.

Operation:


Connect the voltage leads to voltage inputs of the BITE5.

If measuring current, then plug the CT into the BITE5 CT input.




Performing an impedance and discharge test (special testing)


On the BITE5 select “Ω”.

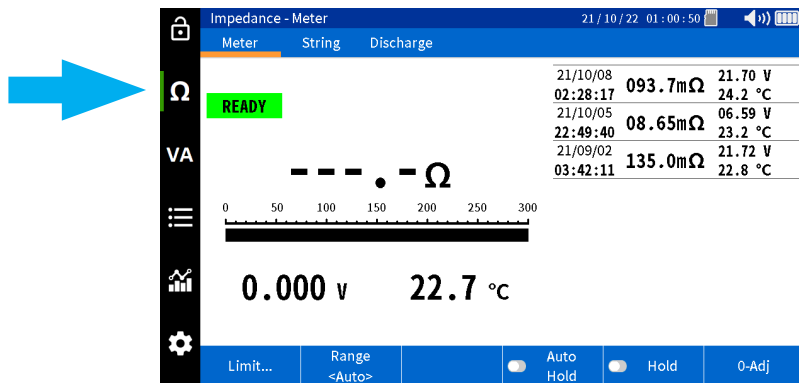


Select “Discharge”.

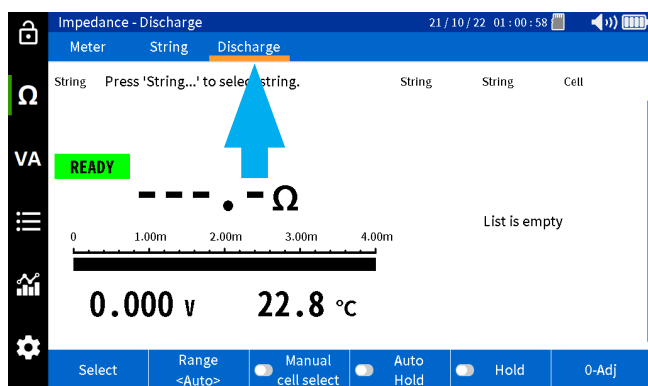

Select “SELECT”.

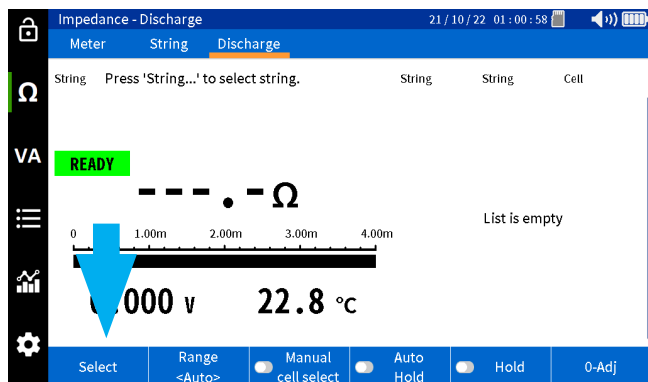


Select desired battery string, then either press “Select Test” to continue a test or select “New Test” to start a new test.

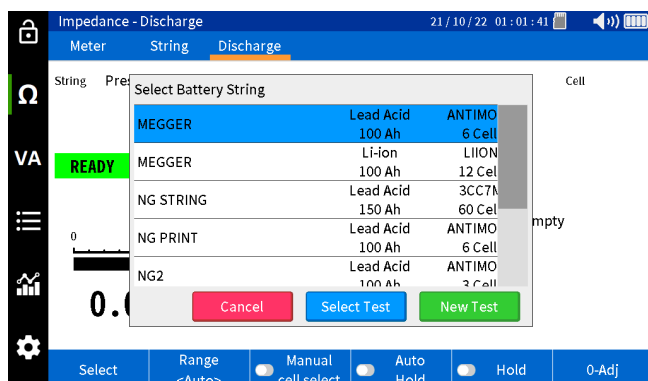


Performing an impedance and discharge test (special testing)


Take measurement of the first cell. The DC voltage and DC current will be saved with a date and time stamp.

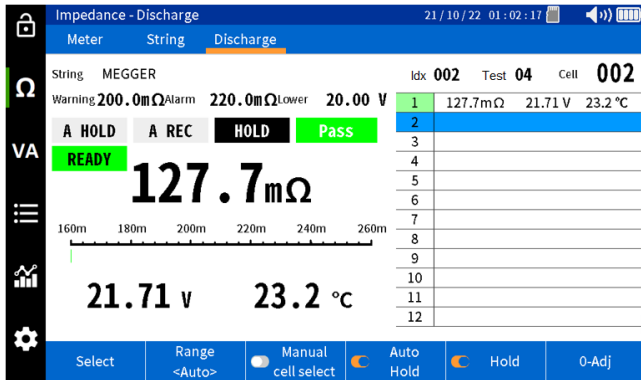

Take measurement of the each following cell. Each measurement shall be saved in sequence with a cell number, date and time stamp.

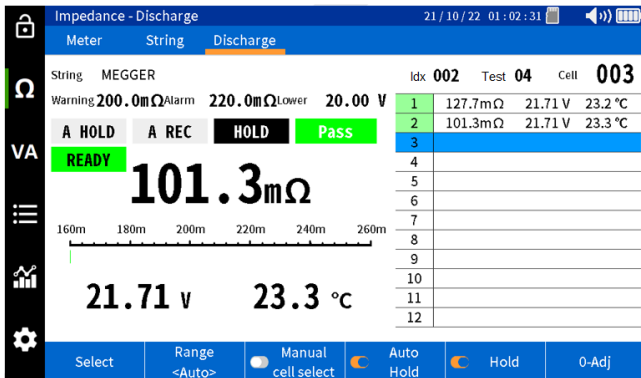

When the end of the string is reached, the unit will prompt the user to either end the test or select next to perform the next pass through the string.

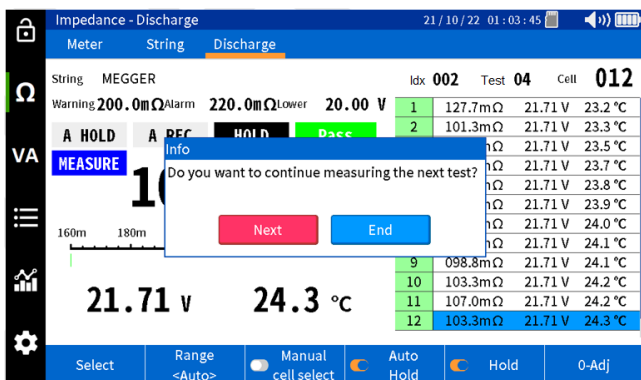

Trending recorded data

Trending recorded impedance data:

The BITE5 will allow trending for the following:

Cell impedance trending – Trends every impedance value of an individual cell.

String impedance trending – Trends the impedance of all cells in a string for a given test.

Cell voltage trending – Trends every voltage value of an individual cell.

String voltage trending – Trends the voltage of all cells in a string for a given test.


Cell temperature trending – Trends every temperature value of an individual cell.

String temperature trending – Trends the temperature of all cells in a string for a given test.


Operation:

Trending individual cells

On the BITE5 select the chart ICON.

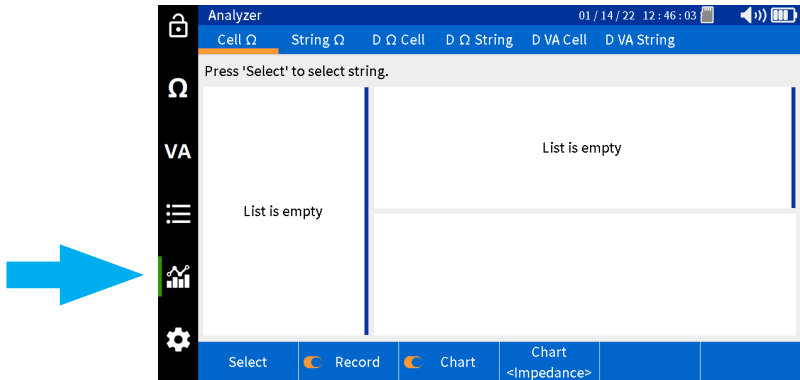


Select "Cell".

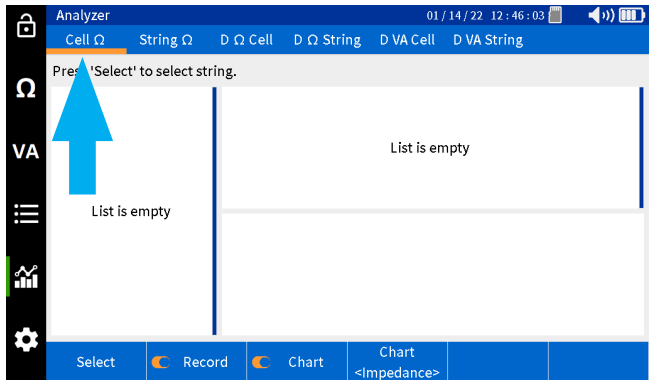


Trending recorded impedance data


Select "Select".

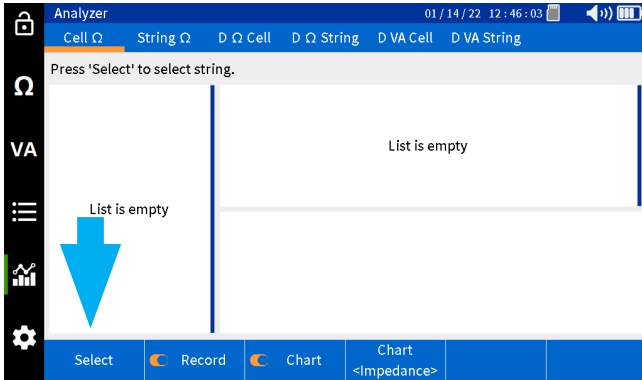


Select string, then press "OK".

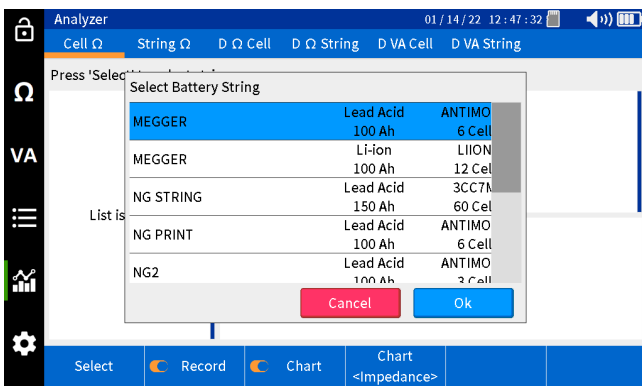

Select desired cell in the left column.

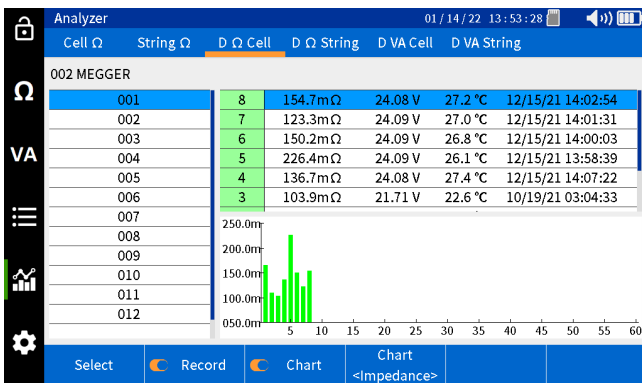


Select "Chart" to change the parameter being trended.

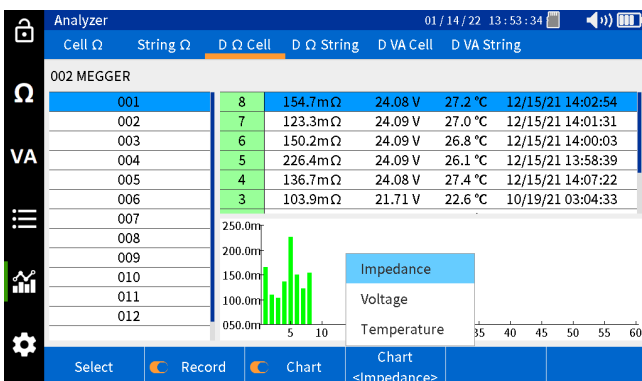


Trending string data


On the BITE5 select the chart ICON.

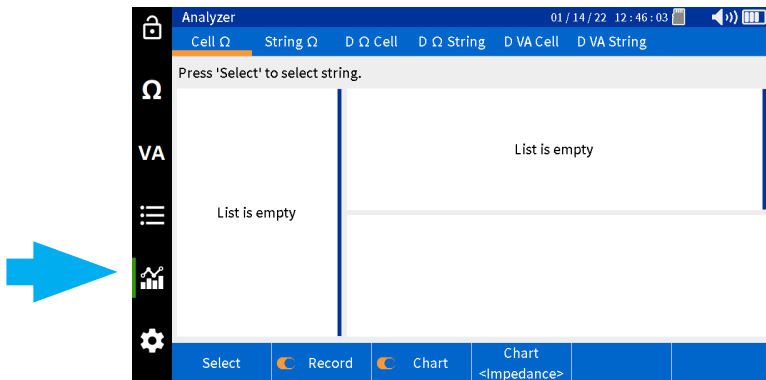

Select "String".

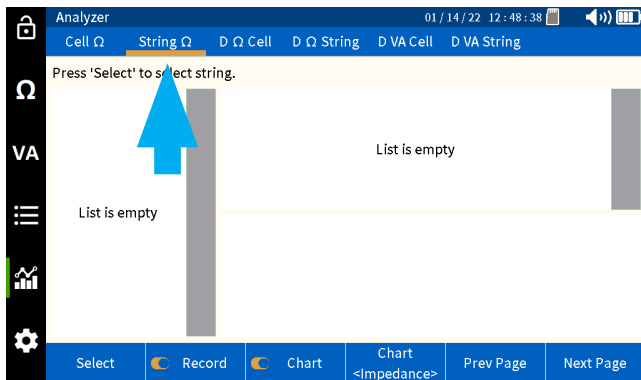


Select "Select".

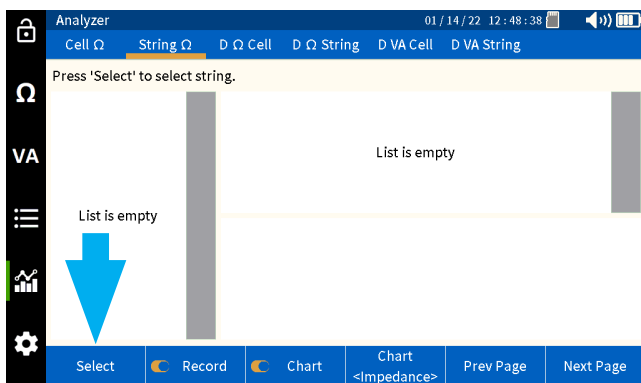


Trending recorded VA discharge data


Select string, then press "OK".

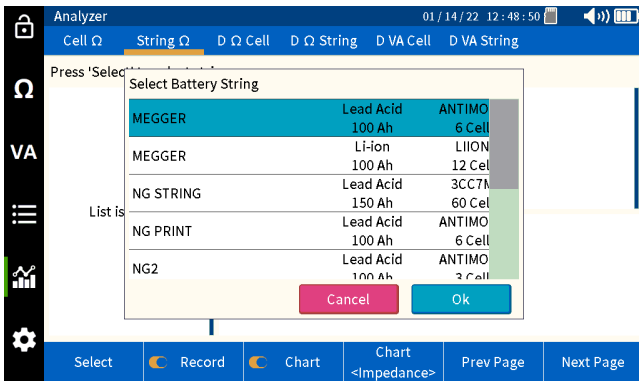

Select the desired test to trend in the left column.

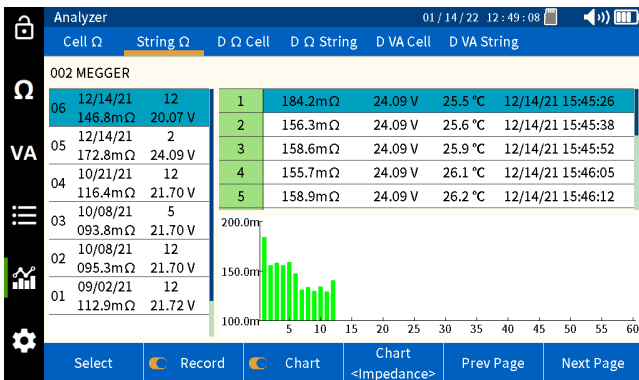

Select "Chart" to change the parameter being trended.

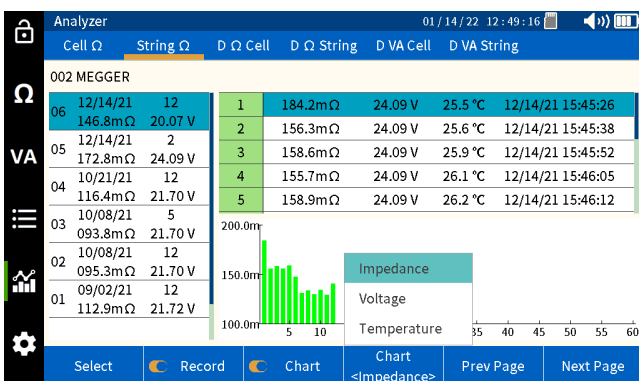

Trending recorded VA discharge data:

The BITE5 will allow trending for the following:

Discharge VA cell voltage trending – Trends every impedance value of an individual cell.

Discharge VA string voltage trending – Trends the impedance of all cells in a string for a given test.


Discharge VA cell current trending – Trends every voltage value of an individual cell.

Discharge VA string current trending – Trends the voltage of all cells in a string for a given test.


Operation:

Trending individual cell data


On the BITE5 select the chart ICON.

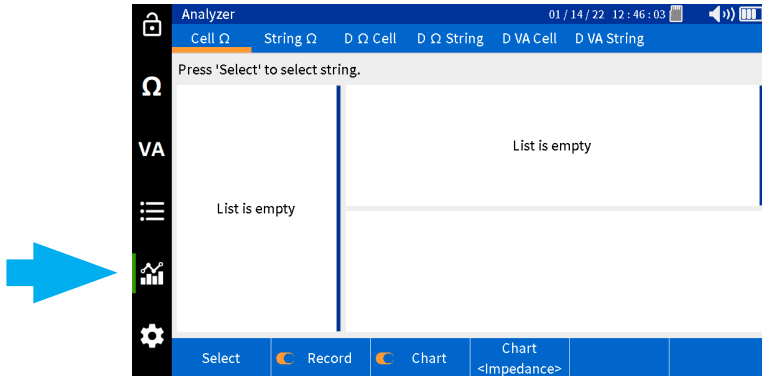

Select "D VA Cell".

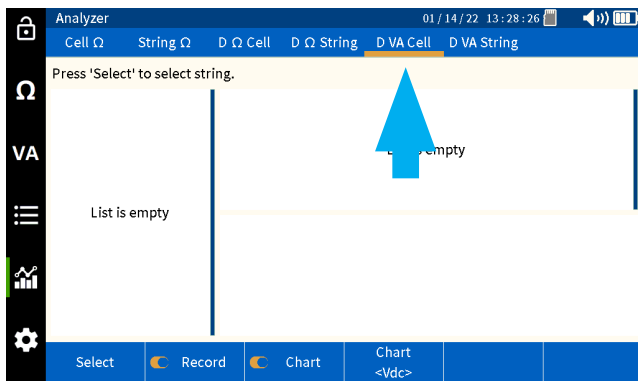


Select "Select".

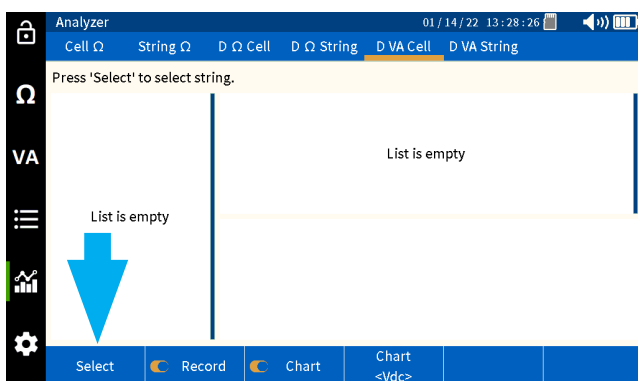


Trending recorded VA discharge data


Select string, then press "OK".

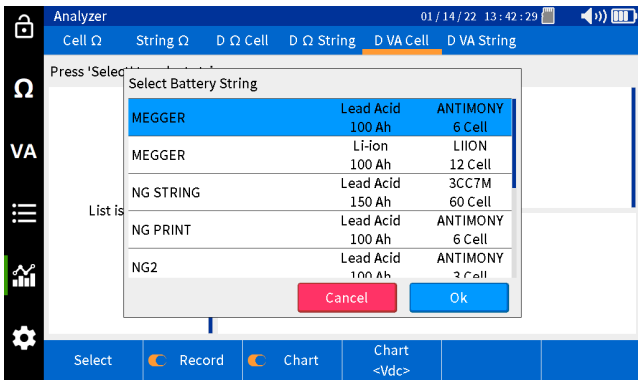

Select desired test in the left column.

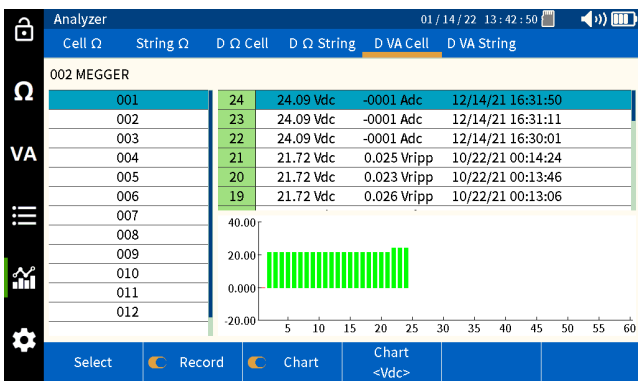


Select "Chart" to change the parameter being trended.

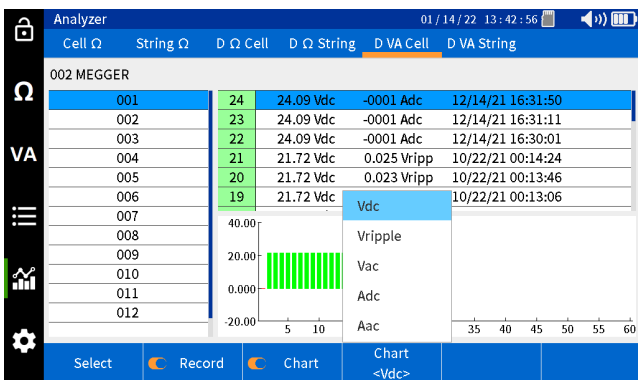


Trending string data

On the BITE5 select the chart ICON.

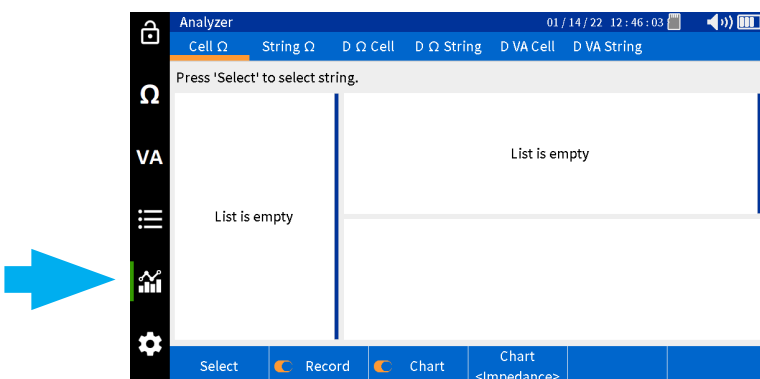


Trending recorded VA discharge data


Select "D VA String".

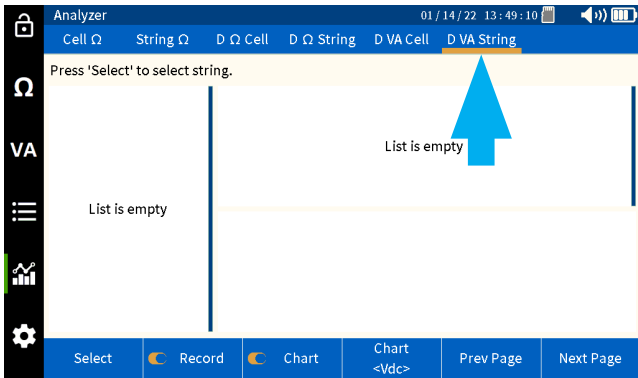


Select "Select".

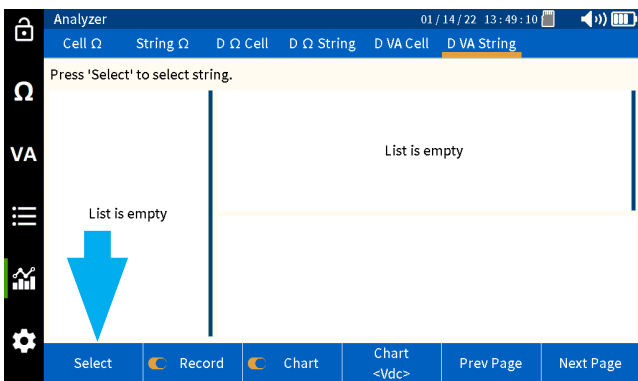

Select string, then press "OK".

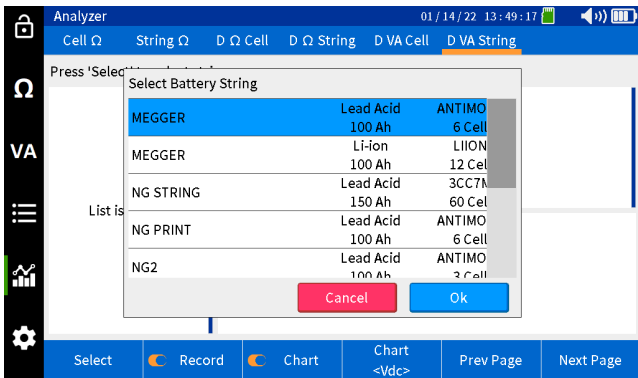


Select the desired test to trend in the left column.

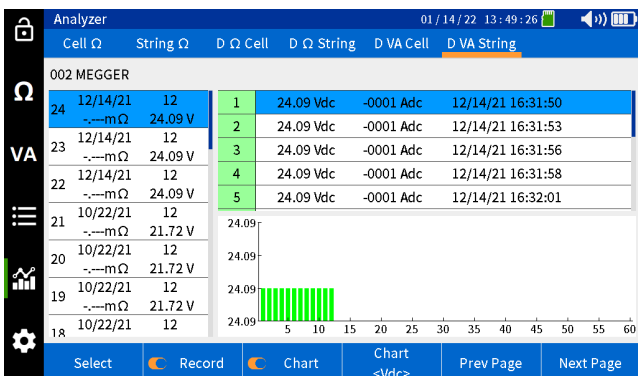

Trending recorded impedance - discharge data

Select "Chart" to change the parameter being trended.

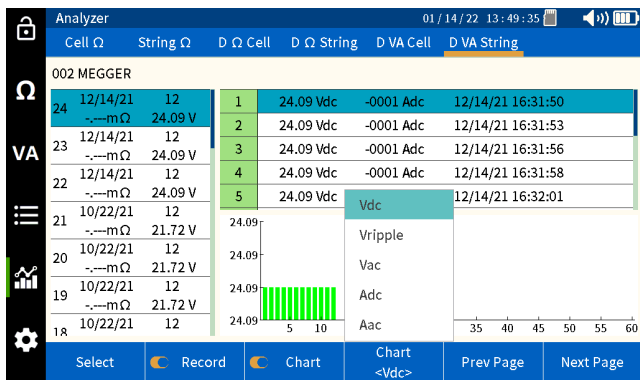

Trending recorded impedance - Discharge data:

The BITE5 will allow trending for the following:

Discharge cell voltage trending – Trends every impedance value of an individual cell.

Discharge string voltage trending – Trends the impedance of all cells in a string for a given test.

Discharge cell impedance trending – Trends every voltage value of an individual cell.

Discharge string impedance trending – Trends the voltage of all cells in a string for a given test.


Discharge cell temperature trending – Trends every temperature value of an individual cell.

Discharge string temperature trending – Trends the temperature of all cells in a string for a given test.

Operation:


Trending individual cell data

On the BITE5 select the chart ICON.

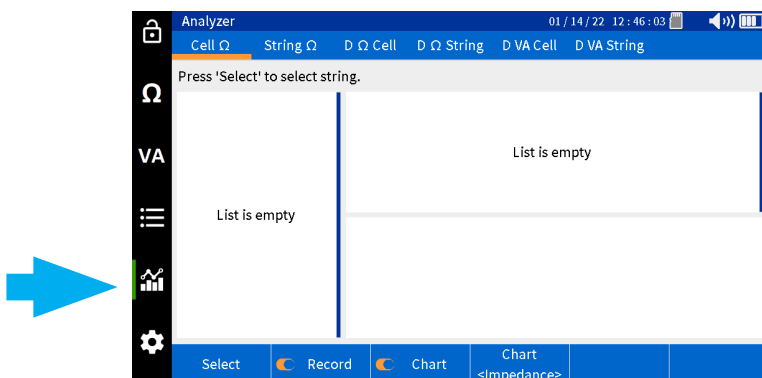


Trending recorded impedance - discharge data


Select "D Ω Cell".

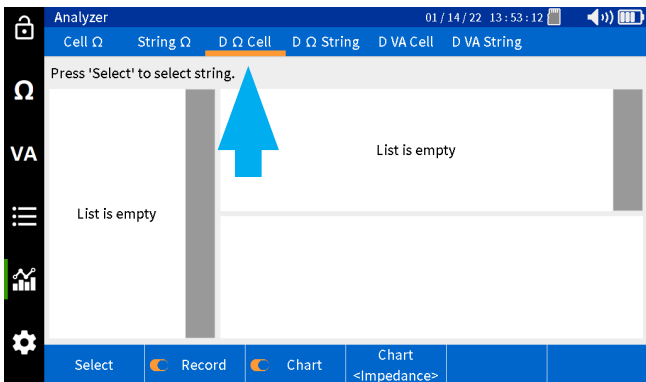


Select "Select".

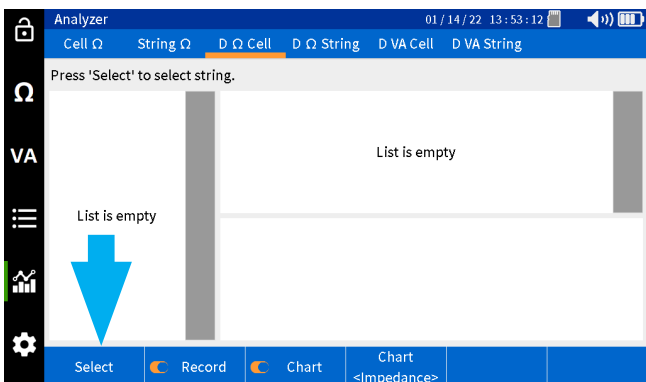

Select string then press "OK".

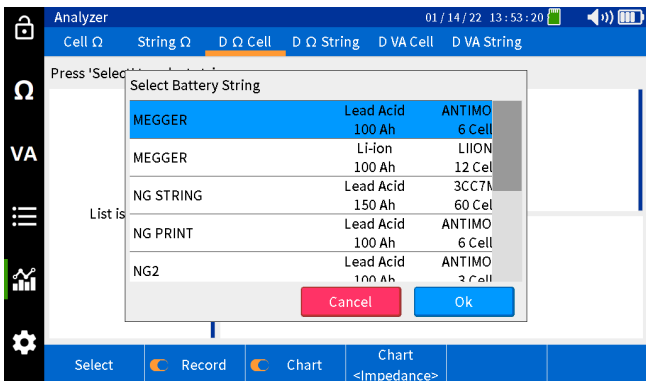


Select desired cell in the left column.

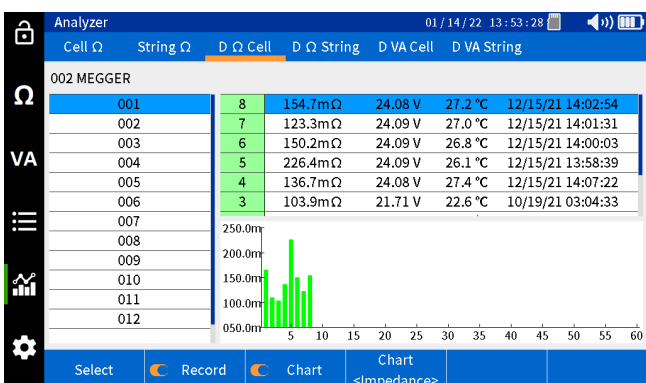


Trending recorded impedance - discharge data

Select "Chart" to change the parameter being trended.

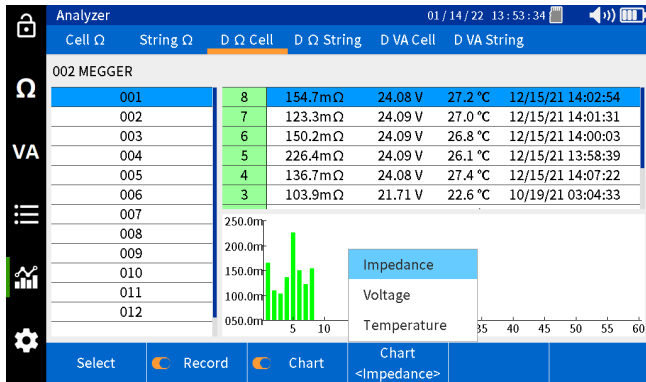


Trending string data

On the BITE5 select the chart ICON.

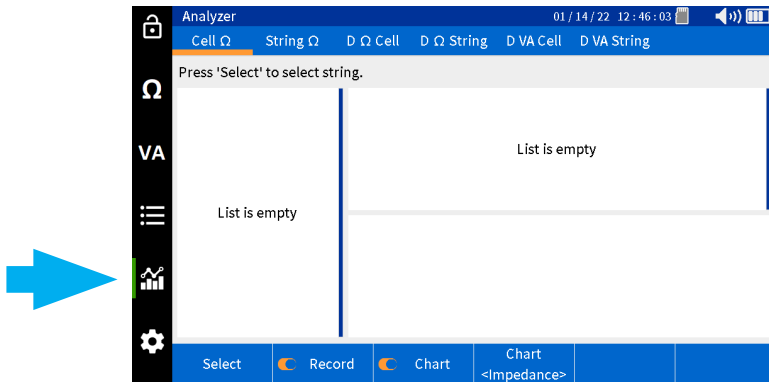


Select "D Ω String".

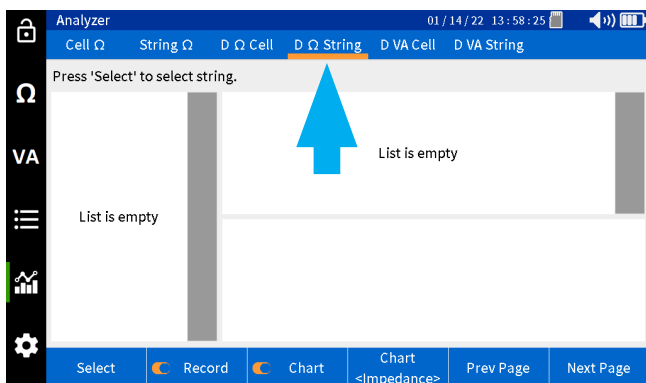


Trending recorded impedance - discharge data


Select "Select".

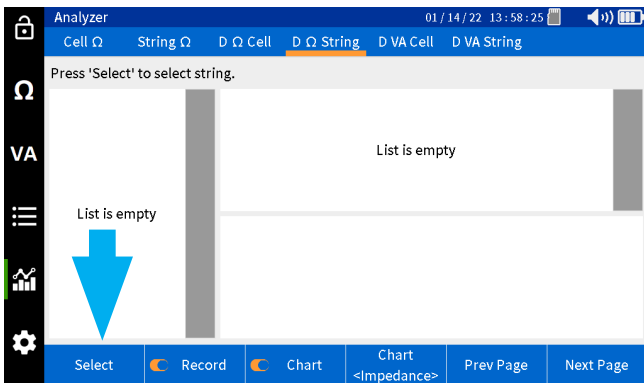


Select string, then press "OK".

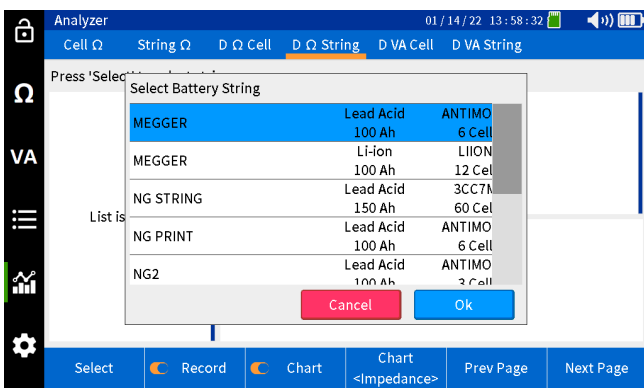

Select desired test in the left column.

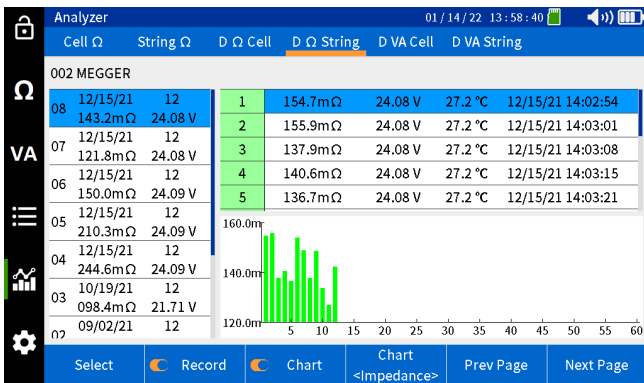

Select "Chart" to change the parameter being trended.

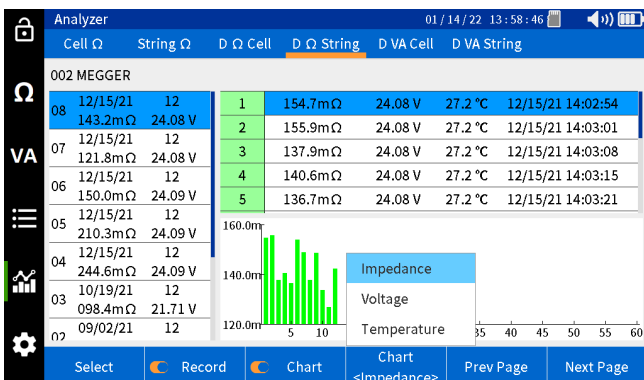

Viewing a record

Viewing a record

The BITE5 allows the viewing of various recorded values or records. These records include the following:

Meter Ω - These will be the individual recorded impedance measurements that were made with the BITE5. These recorded values are not associated with any battery strings.

String Ω - These will be the recorded values of individual impedance tests made on strings.

D Ω String - These will be the recorded values of individual impedance measurements made during a discharge test on a string.


Meter VA - These will be the individual recorded voltage and current measurements that were made with the BITE5. These recorded value are not associated with any battery strings.

String VA - These will be the recorded values of voltage and current measurements made on strings.


D VA String - These will be the recorded values of the voltage and current measurements made during a discharge test on a string.

Viewing Meter Ω records

On the BITE5 select the record ICON.

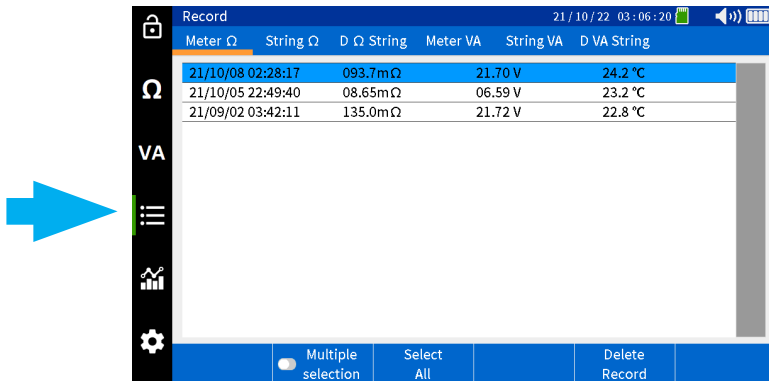


Select "Meter Ω ".

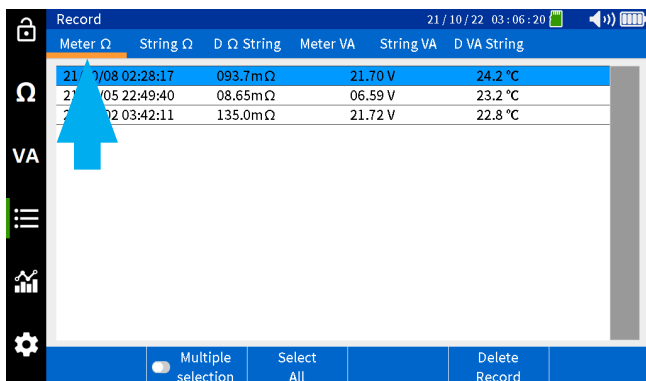

Viewing string impedance records

All recorded values shall be displayed with a date and time stamp.

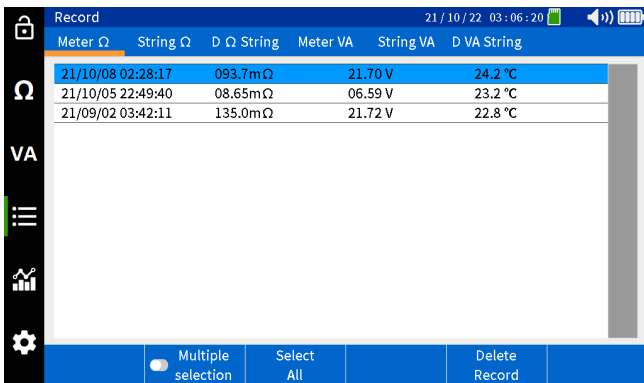


The screenshot shows the 'Record' screen with a table of impedance records. The table has columns for date/time, String Ω , Meter VA, String VA, and D VA String. The records are as follows:

Record	String Ω	Meter VA	String VA	D VA String
21/10/08 02:28:17	093.7m Ω	21.70 V	24.2 °C	
21/10/05 22:49:40	08.65m Ω	06.59 V	23.2 °C	
21/09/02 03:42:11	135.0m Ω	21.72 V	22.8 °C	


Viewing String Ω records

On the BITE5 select the record ICON.

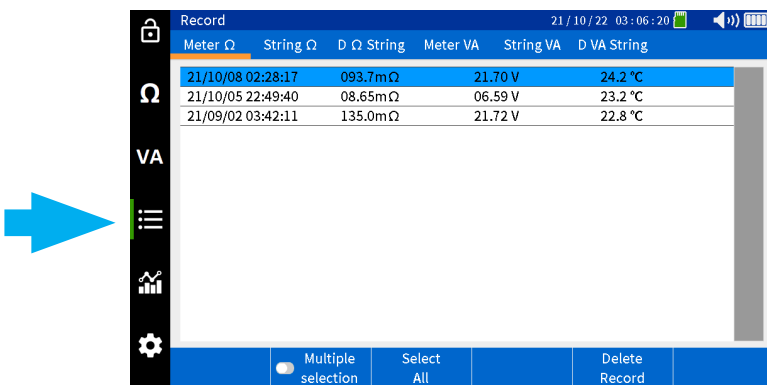

The screenshot shows the 'Record' screen with a blue arrow pointing to the record icon (three horizontal lines) in the left sidebar.


Select "String Ω ".

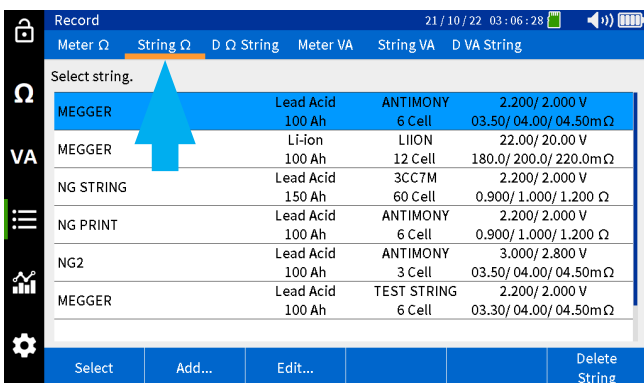

The screenshot shows the 'Record' screen with 'String Ω ' selected in the top menu. A list of strings is displayed with a blue arrow pointing to the first row.

Select string.				
MEGGER	Lead Acid 100 Ah	ANTIMONY 6 Cell	2.200/ 2.000 V	03.50/ 04.00/ 04.50m Ω
MEGGER	Li-ion 100 Ah	LIION 12 Cell	22.00/ 20.00 V	180.0/ 200.0/ 220.0m Ω
NG STRING	Lead Acid 150 Ah	3CC7M 60 Cell	2.200/ 2.000 V	0.900/ 1.000/ 1.200 Ω
NG PRINT	Lead Acid 100 Ah	ANTIMONY 6 Cell	2.200/ 2.000 V	0.900/ 1.000/ 1.200 Ω
NG2	Lead Acid 100 Ah	ANTIMONY 3 Cell	3.000/ 2.800 V	03.50/ 04.00/ 04.50m Ω
MEGGER	Lead Acid 100 Ah	TEST STRING 6 Cell	2.200/ 2.000 V	03.30/ 04.00/ 04.50m Ω

Select desired string, then press "Select".

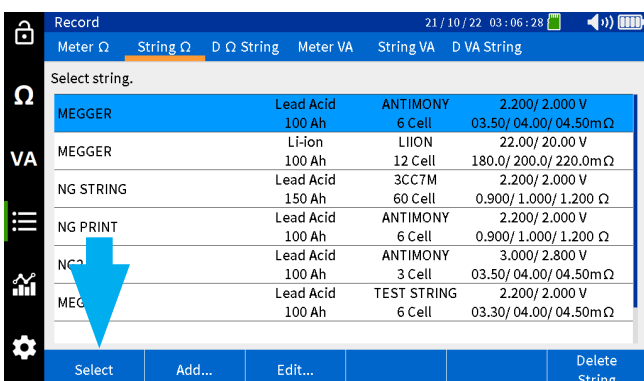

The screenshot shows the 'Record' screen with 'String Ω ' selected in the top menu. A list of strings is displayed with a blue arrow pointing to the 'Select' button at the bottom.

Select string.				
MEGGER	Lead Acid 100 Ah	ANTIMONY 6 Cell	2.200/ 2.000 V	03.50/ 04.00/ 04.50m Ω
MEGGER	Li-ion 100 Ah	LIION 12 Cell	22.00/ 20.00 V	180.0/ 200.0/ 220.0m Ω
NG STRING	Lead Acid 150 Ah	3CC7M 60 Cell	2.200/ 2.000 V	0.900/ 1.000/ 1.200 Ω
NG PRINT	Lead Acid 100 Ah	ANTIMONY 6 Cell	2.200/ 2.000 V	0.900/ 1.000/ 1.200 Ω
NG2	Lead Acid 100 Ah	ANTIMONY 3 Cell	3.000/ 2.800 V	03.50/ 04.00/ 04.50m Ω
MEGGER	Lead Acid 100 Ah	TEST STRING 6 Cell	2.200/ 2.000 V	03.30/ 04.00/ 04.50m Ω

Viewing D Ω String records

Select desired test in the left column.

The screenshot shows the software interface with the 'String Ω' tab selected. The left column displays a list of test records for '002 MEGGER'. A blue arrow points to the record with date '21/10/02' and time '12'. The right column shows a detailed view of this record, listing 12 test results with columns for test number, resistance (Ω), voltage (V), temperature (°C), and timestamp.

Test No.	Resistance (Ω)	Voltage (V)	Temperature (°C)	Timestamp
1	136.4mΩ	21.70 V	24.0 °C	21/10/21 04:48:29
2	149.7mΩ	21.70 V	24.1 °C	21/10/21 04:48:44
3	129.8mΩ	21.70 V	24.2 °C	21/10/21 04:48:57
4	110.8mΩ	21.70 V	24.3 °C	21/10/21 04:49:04
5	112.1mΩ	21.70 V	24.3 °C	21/10/21 04:49:11
6	111.1mΩ	21.70 V	24.4 °C	21/10/21 04:49:18
7	112.5mΩ	21.70 V	24.5 °C	21/10/21 04:49:25
8	107.9mΩ	21.70 V	24.6 °C	21/10/21 04:49:32
9	107.5mΩ	21.70 V	24.8 °C	21/10/21 04:49:39
10	107.6mΩ	21.70 V	24.9 °C	21/10/21 04:49:46
11	104.8mΩ	21.70 V	25.0 °C	21/10/21 04:49:53
12	106.2mΩ	21.70 V	25.1 °C	21/10/21 04:50:00

Recorded values will be displayed in the right column.

This screenshot is identical to the previous one, showing the detailed view of the selected record. The right column displays the recorded values for that record.

Viewing D Ω String records

On the BITE5 select the record ICON.

The screenshot shows the software interface with the 'String Ω' tab selected. The left column displays a list of test records. A blue arrow points to the record icon in the left column.


Date/Time	Resistance (Ω)	Voltage (V)	Temperature (°C)
21/10/08 02:28:17	093.7mΩ	21.70 V	24.2 °C
21/10/05 22:49:40	08.65mΩ	06.59 V	23.2 °C
21/09/02 03:42:11	135.0mΩ	21.72 V	22.8 °C

Select "D Ω String".


The screenshot shows the software interface with the 'D Ω String' tab selected. The right column displays the recorded values for that record.

Test No.	Resistance (Ω)	Voltage (V)	Temperature (°C)	Timestamp
1	103.9mΩ	21.71 V	22.6 °C	21/10/19 03:04:33
2	096.6mΩ	21.71 V	22.7 °C	21/10/19 03:05:00
3	098.6mΩ	21.71 V	22.9 °C	21/10/19 03:05:16
4	098.1mΩ	21.71 V	23.0 °C	21/10/19 03:05:24
5	097.1mΩ	21.71 V	23.1 °C	21/10/19 03:05:32
6	097.1mΩ	21.71 V	23.2 °C	21/10/19 03:05:39
7	096.8mΩ	21.71 V	23.3 °C	21/10/19 03:05:46
8	097.3mΩ	21.71 V	23.5 °C	21/10/19 03:05:53
9	098.5mΩ	21.71 V	23.6 °C	21/10/19 03:06:00
10	098.4mΩ	21.71 V	23.7 °C	21/10/19 03:06:06
11	098.6mΩ	21.71 V	23.8 °C	21/10/19 03:06:13
12	100.3mΩ	21.71 V	23.9 °C	21/10/19 03:06:20


Select desired string, then press "Select".

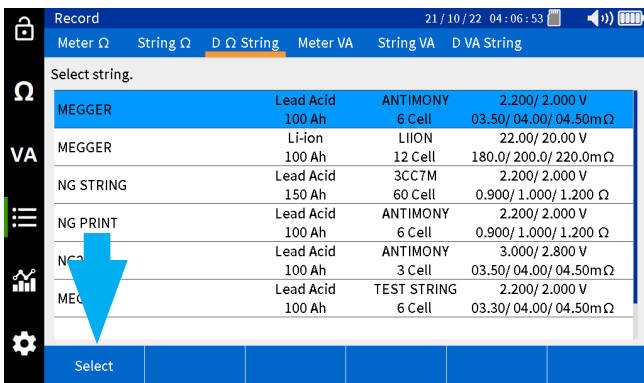

Select desired test in the left column.

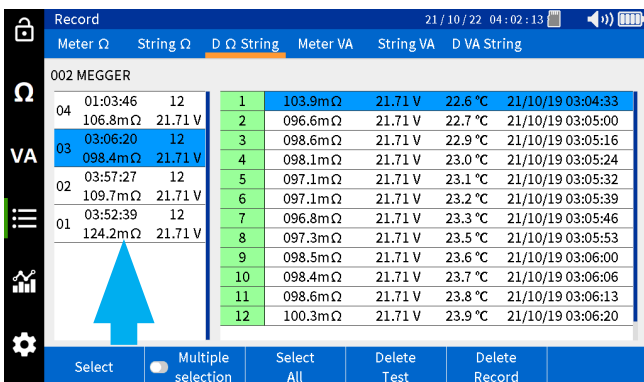


Recorded values will be displayed in the right column.

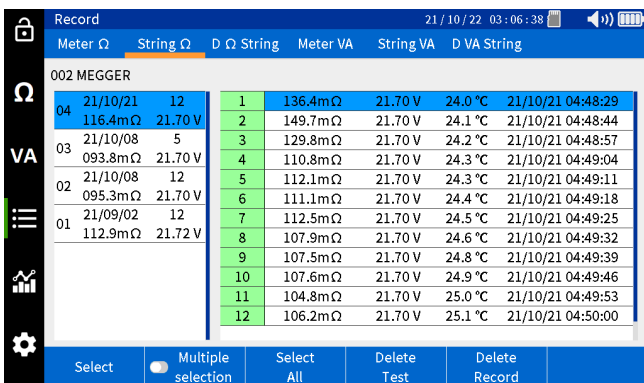

Viewing Meter VA records

On the BITE5 select the record ICON.

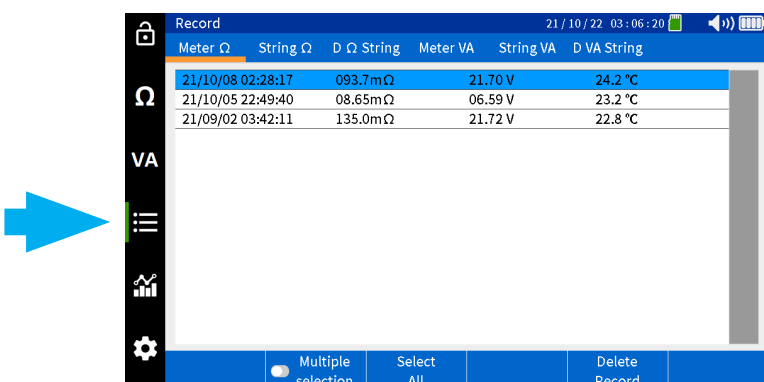

Viewing string VA records

Select "Meter VA".

Record	Meter VA	String VA	D VA String
21/10/22 00:42:42	0.002 V	0.000 V	
21/10/16 02:29:35	21.72 V	0.023 V	
21/10/16 02:29:21	0.034 V	0.029 V	
21/10/16 00:19:09	21.70 V	0.026 V	
21/10/16 00:18:16	21.70 V	0.028 V	
21/10/05 23:10:25	26.32 V	-0.008 A	
21/10/05 23:09:58	00.28 V	04.54 A	
21/09/01 04:07:55	0.003 V	0000 A	
21/09/01 04:07:51	0.003 V	0000 A	

All recorded values will be displayed with a date and time stamp.

Record	Meter VA	String VA	D VA String
21/10/22 00:42:42	0.002 V	0.000 V	
21/10/16 02:29:35	21.72 V	0.023 V	
21/10/16 02:29:21	0.034 V	0.029 V	
21/10/16 00:19:09	21.70 V	0.026 V	
21/10/16 00:18:16	21.70 V	0.028 V	
21/10/05 23:10:25	26.32 V	-0.008 A	
21/10/05 23:09:58	00.28 V	04.54 A	
21/09/01 04:07:55	0.003 V	0000 A	
21/09/01 04:07:51	0.003 V	0000 A	

Viewing string VA records

On the BITE5 select the record ICON.


Record	String VA	Meter VA	D VA String
21/10/08 02:28:17	093.7mΩ	21.70 V	24.2 °C
21/10/05 22:49:40	08.65mΩ	06.59 V	23.2 °C
21/09/02 03:42:11	135.0mΩ	21.72 V	22.8 °C

Select "String VA".


Record	String VA	Meter VA	D VA String
MEGGER	Lead Acid 100 Ah	ANTIMONY	2.200/ 2.000 V 03.50/ 04.00/ 04.50mΩ
MEGGER	Li-ion 100 Ah	3 Cell	22.00/ 20.00 V 180.0/ 200.0/ 220.0mΩ
NG STRING	Lead Acid 150 Ah	3CC7M 60 Cell	2.200/ 2.000 V 0.900/ 1.000/ 1.200 Ω
NG PRINT	Lead Acid 100 Ah	ANTIMONY 6 Cell	2.200/ 2.000 V 0.900/ 1.000/ 1.200 Ω
NG2	Lead Acid 100 Ah	ANTIMONY 3 Cell	3.000/ 2.800 V 03.50/ 04.00/ 04.50mΩ
MEGGER	Lead Acid 100 Ah	TEST STRING 6 Cell	2.200/ 2.000 V 03.30/ 04.00/ 04.50mΩ

Viewing D VA String records

Select desired string, then press on "Select".

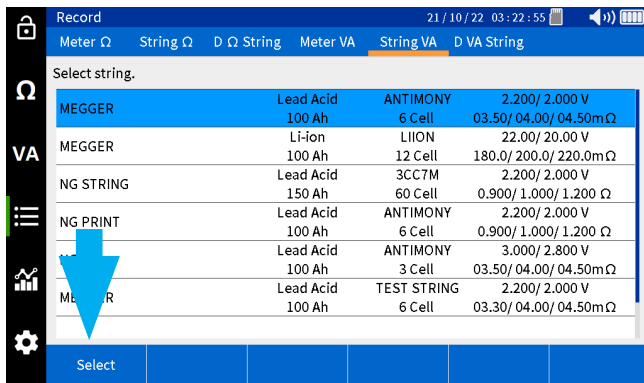


All recorded values will be displayed with a date and time stamp.

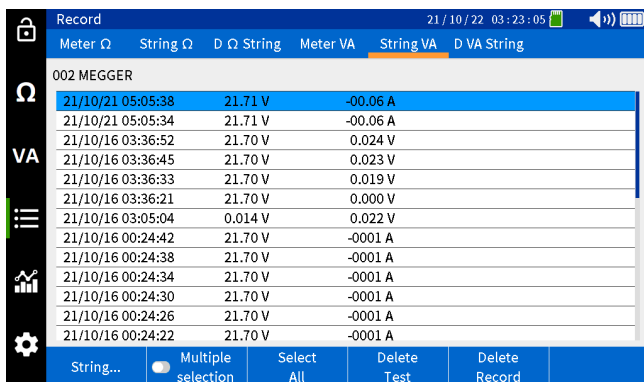


Viewing D VA String records

On the BITE5 select the record ICON.

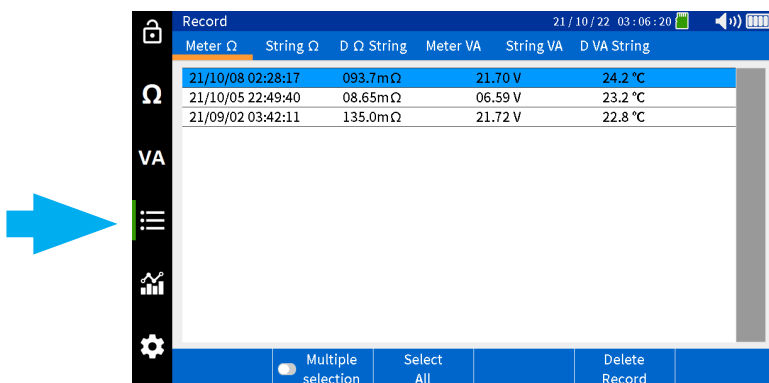


Select "D VA String".

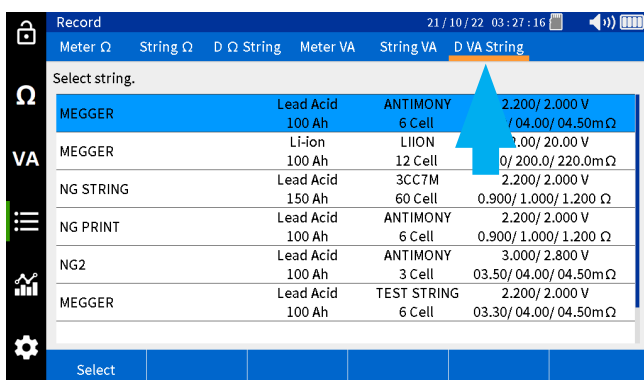


Viewing D VA String records


Select desired string, then press on "Select".

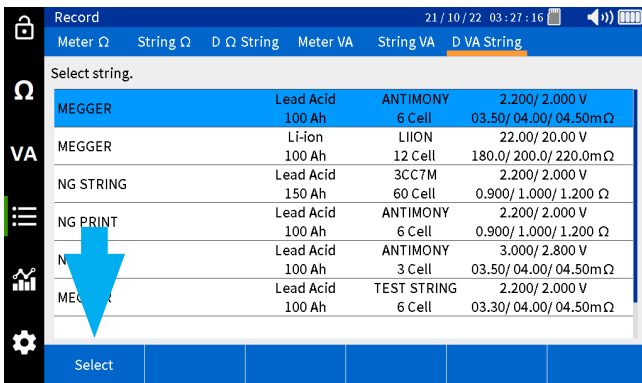

Select desired test in the left column.

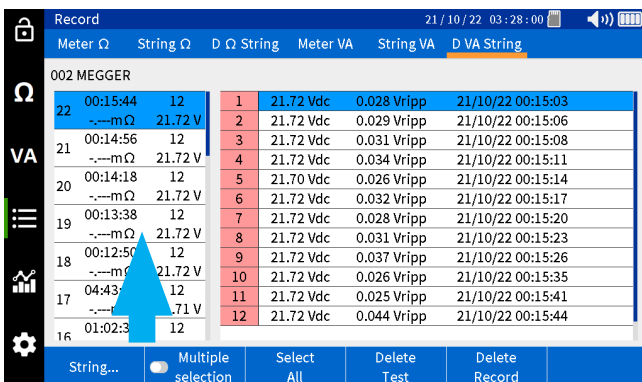

Recorded values will be displayed in the right column.

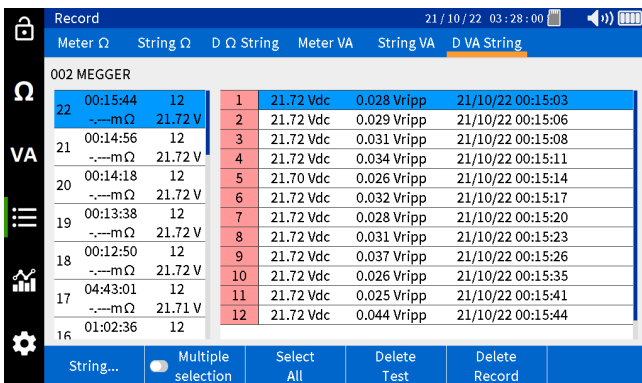


Deleting recorded data


Deleting Meter Ω data

This refers to the impedance measurements not associated with a battery string.


On the BITE5 select the record ICON.

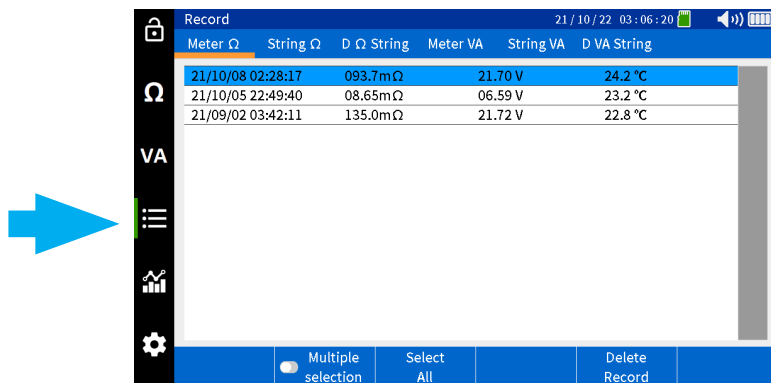

Select "Meter Ω ".

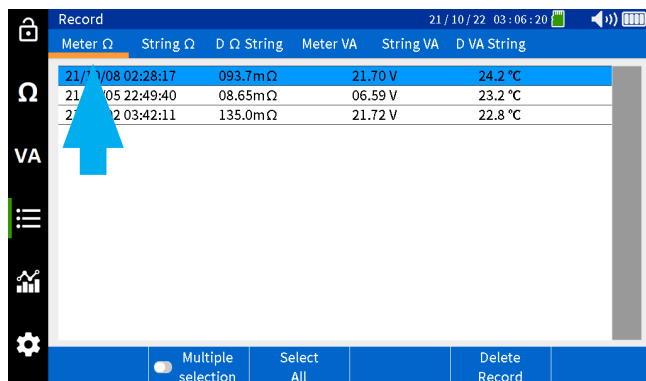


Select desired measurement, then select "Delete Record".

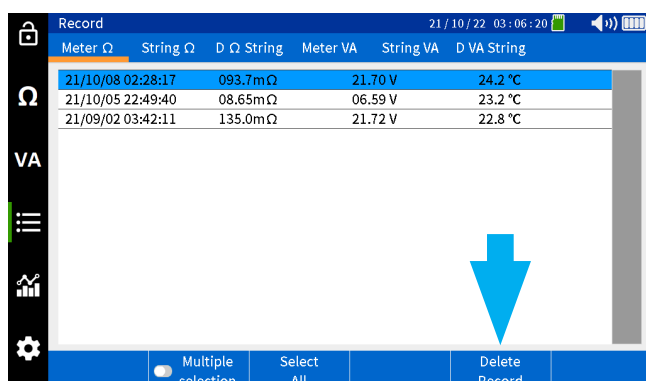

Deleting D Ω String data


To delete all records, select "Select All" then select "Delete Record".

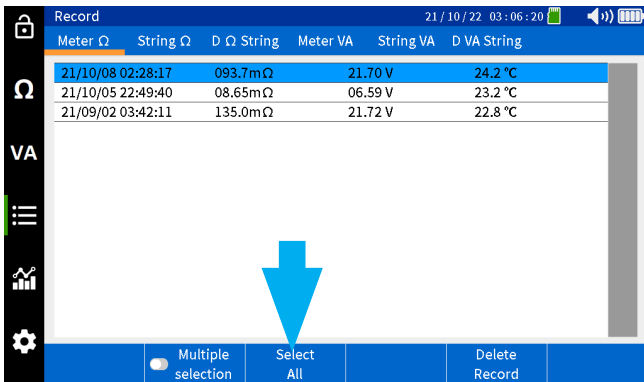


Deleting D Ω String data

This is impedance data recorded during a discharge test.


On the BITE5 select the record ICON.

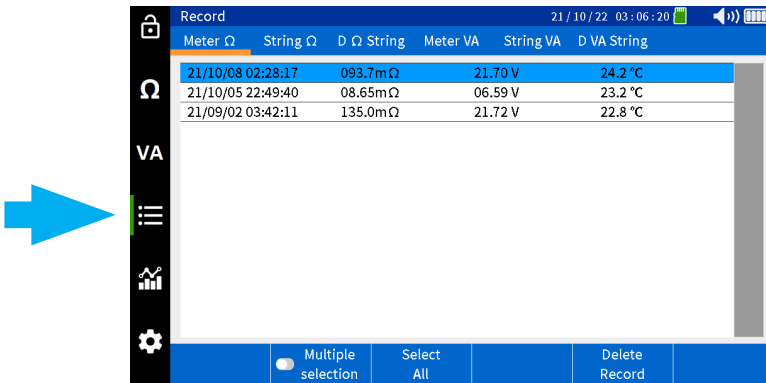


Select "D Ω String".

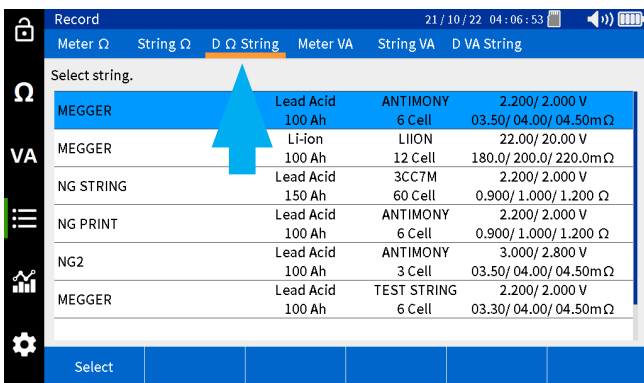


Select desired string, then press "Select".

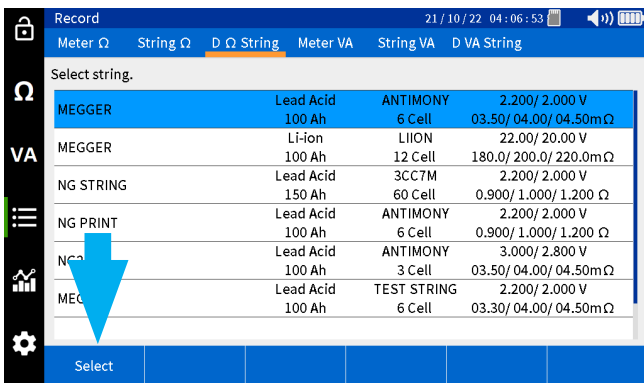

Select desired test in the left column, then press "Delete Test" to delete the test.

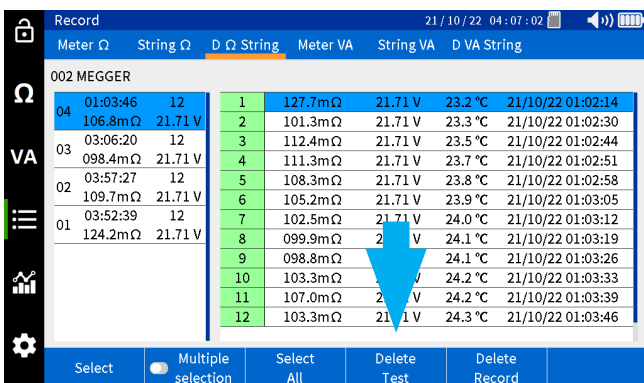

To delete an individual record, select the desired record on in the right column then select "Delete Record".

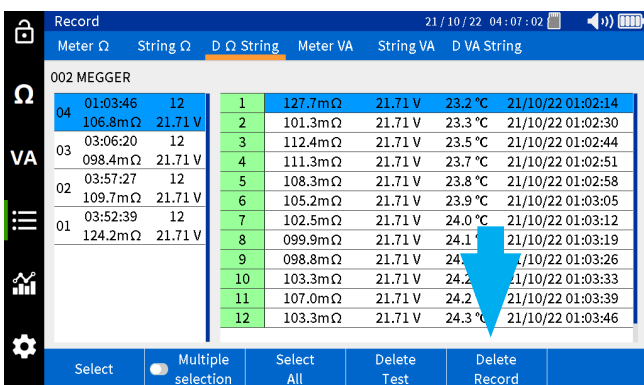


Deleting Meter VA data


Deleting Meter VA data

This refers to the voltage and current measurements not associated with a battery string.


On the BITE5 select the record ICON.

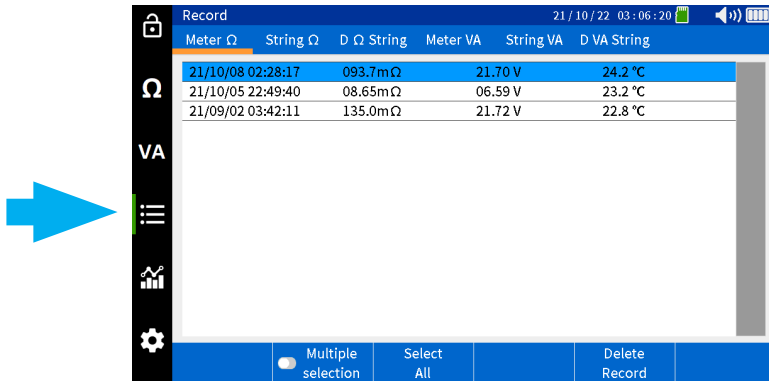


Select "Meter VA".

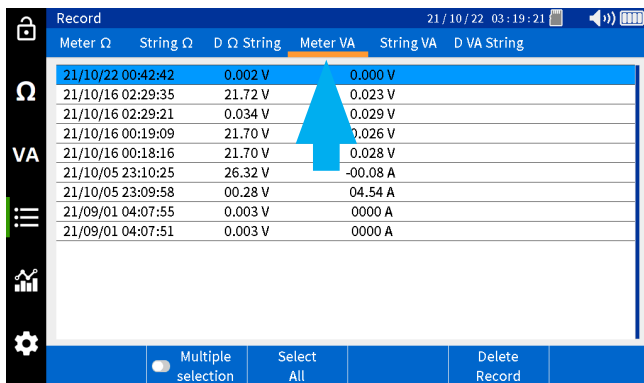

Select desired measurement, then select "Delete Record".

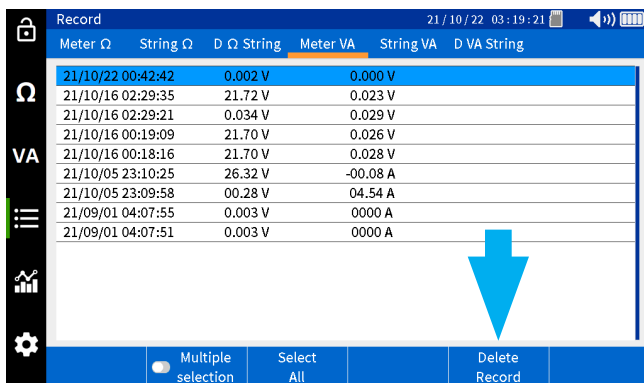


To delete all records, select "Select All" then select "Delete Record".

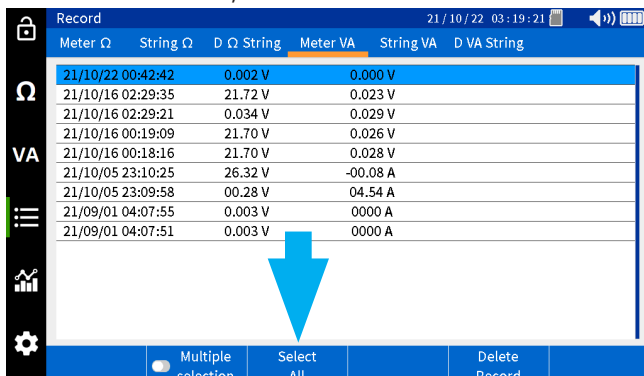


Deleting String VA data

This refers to the voltage and current measurements associated with a particular battery string.


On the BITE5 select the record ICON.

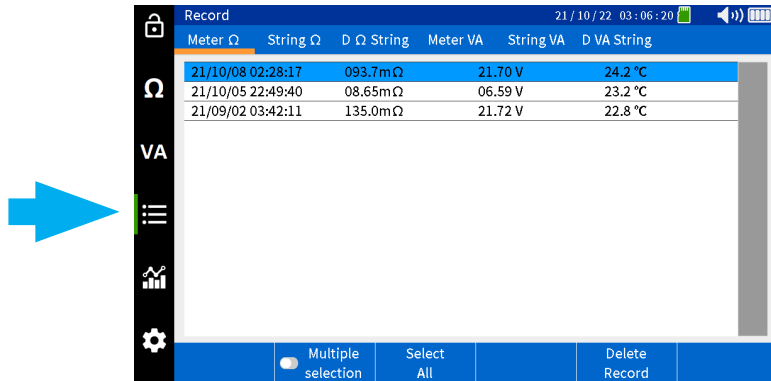

Select "String VA".

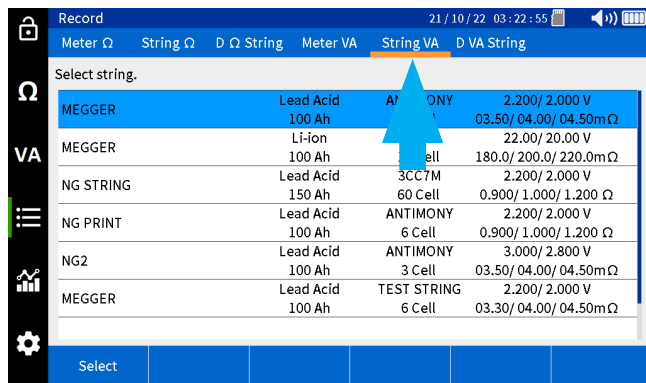

Select desired string, then press "Select".

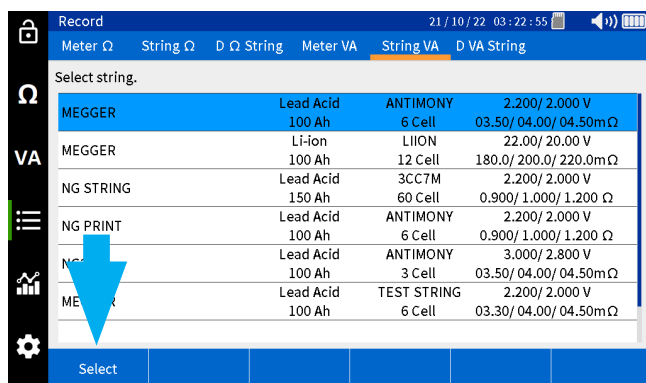

Deleting D VA String data

Select desired record, then select "Delete Record".

Record	String Ω	D Ω String	Meter VA	String VA	D VA String
21/10/21 05:05:38	21.71 V	-00.06 A			
21/10/21 05:05:34	21.71 V	-00.06 A			
21/10/16 03:36:52	21.70 V	0.024 V			
21/10/16 03:36:45	21.70 V	0.023 V			
21/10/16 03:36:33	21.70 V	0.019 V			
21/10/16 03:36:21	21.70 V	0.000 V			
21/10/16 03:05:04	0.014 V	0.022 V			
21/10/16 00:24:42	21.70 V	-0001 A			
21/10/16 00:24:38	21.70 V	-0001 A			
21/10/16 00:24:34	21.70 V	-0001 A			
21/10/16 00:24:30	21.70 V	-0001 A			
21/10/16 00:24:26	21.70 V	-0001 A			
21/10/16 00:24:22	21.70 V	-0001 A			

Deleting D VA String data

This refers to the recorded voltages taken during a discharge test.

On the BITE5 select the record ICON.


Record	String Ω	D Ω String	Meter VA	String VA	D VA String
21/10/08 02:28:17	093.7m Ω	21.70 V	24.2 °C		
21/10/05 22:49:40	08.65m Ω	06.59 V	23.2 °C		
21/09/02 03:42:11	135.0m Ω	21.72 V	22.8 °C		

Select "D VA String".


Record	String Ω	D Ω String	Meter VA	String VA	D VA String
MEGGER	Lead Acid 100 Ah	ANTIMONY 6 Cell	2.200/ 2.000 V 0.04.00/ 04.50m Ω		
MEGGER	Li-ion 100 Ah	LIION 12 Cell	2.200/ 2.000 V 0.00/ 20.00 V 0.00/ 200.0/ 220.0m Ω		
NG STRING	Lead Acid 150 Ah	3CC7M 60 Cell	2.200/ 2.000 V 0.900/ 1.000/ 1.200 Ω		
NG PRINT	Lead Acid 100 Ah	ANTIMONY 6 Cell	2.200/ 2.000 V 0.900/ 1.000/ 1.200 Ω		
NG2	Lead Acid 100 Ah	ANTIMONY 3 Cell	3.000/ 2.800 V 03.50/ 04.00/ 04.50m Ω		
MEGGER	Lead Acid 100 Ah	TEST STRING 6 Cell	2.200/ 2.000 V 03.30/ 04.00/ 04.50m Ω		

Deleting D VA String data


Select desired string, then press "Select".

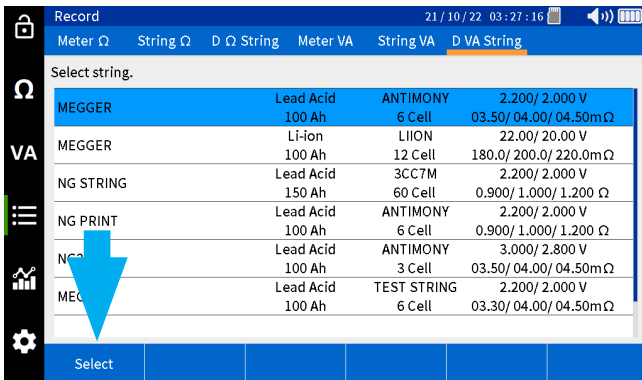

Select desired test in the left column, then select "Delete Test".

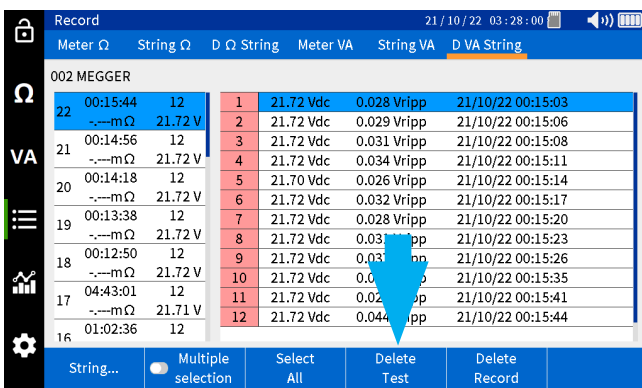


To delete an individual record, select the desired record on in the right column then select "Delete Record".

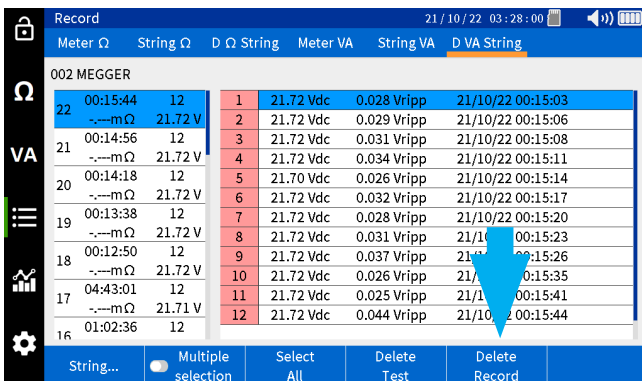


Deleting a string configuration

Deleting a string configuration


On the BITE5 select the record ICON.

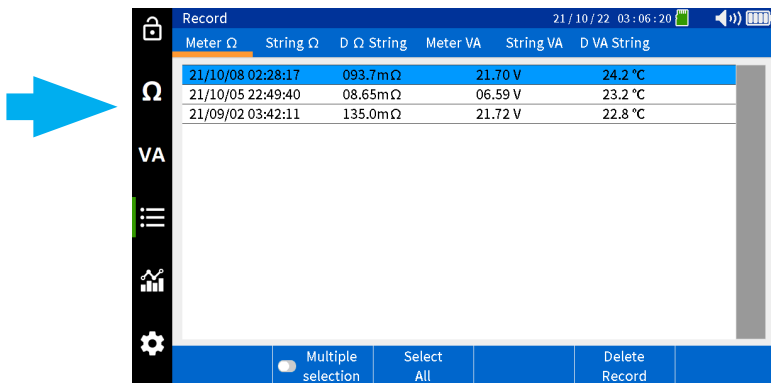

Select "String Ω ".

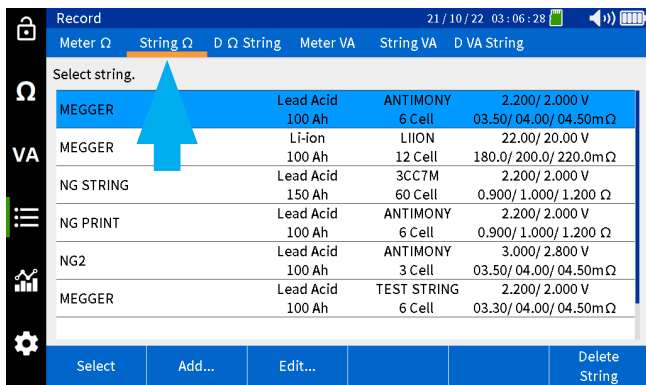

Select desired string then press "Delete String".

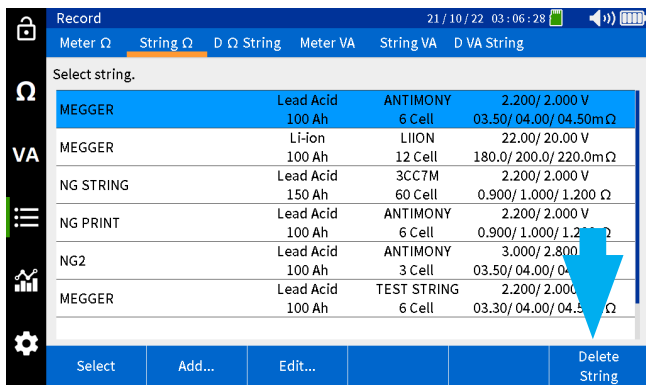

Saving a screen snapshot

The BITE5 allows you to save screen images as bitmaps.

To do this, momentarily press and release the Power ON/OFF button.



The displayed screen shall be saved to the SD card as a bitmap file.

The bitmap will be located at the following path.

\\MEGGER\PQA\SNAPSHOT

Accessories

Accessories

Description	Image	Part Number
<p>Concentric Probes. These allow measurements of cells through battery caps that have probe access ports.</p> <p>These probes come with either 11.75 mm (1/4") tips or 25.4 mm (1") tips.</p>		<p>90037-562 (11.75 mm (1/4") tips)</p> <p>90037-565 (25.4 mm (1") tips)</p>

Maintenance

Do not leave the instrument connected to the system under test when not in use.

Do not use the instrument or connect it to any external system if it shows any visible signs of damage, malfunction, or if it has been stored in unfavorable conditions.

If this equipment is used in the manner not specified by the manufacturer, the protection provided by the equipment may be impaired.

Battery charging







The BITE5 uses rechargeable Li-ion batteries. Only recharge batteries using the supplied power adapter.

Battery charging starts once the power adapter is connected and plugged into AC.

The battery charge will take approx. 4 hours to complete. If the unit is operated off of the AC adapter, then the charging time will be longer.

The BITE5 can be left connected to the charging adapter for extended periods. The batteries will not be damaged even after full charge.

Battery charging status icon

Icon	Descriptions
	Battery charging amount more than 85 %
	Battery charging amount more than 70 %
	Battery charging amount more than 50 %
	Battery charging amount more than 25 %
	Battery is fully discharged (after warning sounds, unit will shut off)
	Adapter connected, unit charging

Maintenance

Cleaning and Storage

Do not leave the instrument connected to the system under test when storing or cleaning.

Unit Cleaning

Clean with wet cloth and soft soap. Do not use organic solvents or alcohol as markings on the unit may be damaged.

Storage

When storing for long periods of time, there is no need to remove the battery pack.

However, all batteries experience self-discharge. This will lead to a gradually draining of the batteries.

For best battery life, it is recommended that batteries are charged once a month.

Batteries need to be charged a minimum of once every 6 months.

Cleaning probes

Clean with wet cloth and soft soap. Do not use organic solvents or alcohol.

Manufacturing sites

Megger Limited
Archcliffe Road
Dover
Kent
CT17 9EN
ENGLAND
T. +44 (0)1 304 502101
F. +44 (0)1 304 207342

Megger GmbH
Weststraße 59
52074
Aachen
Germany
T. +49 (0) 241 91380 500
E. info@megger.de

Megger USA - Valley Forge
Valley Forge Corporate Center
2621 Van Buren Avenue
Norristown
Pennsylvania, 19403
USA
T. 1-610 676 8500
F. 1-610-676-8610

Megger USA - Dallas
4545 West Davis Street
Dallas
75211-3422
T. +1 214 333 3201
F. +1 214 331 7399
USSales@megger.com

Megger AB
Rinkebyvägen 19, Box 724,
SE-182 17
DANDERYD
T. 08 510 195 00
E. seinfo@megger.com

Megger Baker
4812 McMurry Avenue
80525
USA
T. +1 970-282-1200
E. baker.sales@megger.com

The company reserves the right to change the specification or design without prior notice.

Megger is a registered trademark

The Bluetooth[®] word mark and logos are registered trademarks owned by Bluetooth SIG, Inc and is used under licence.

Part No: BITE5_UG_EN_V01